



MONTARA WATER AND SANITARY DISTRICT AGENDA

Prepared for the Meeting Of: October 15, 2026

TO: BOARD OF DIRECTORS

FROM: Clemens H. Heldmaier, General Manager 

SUBJECT: SAM Flow Report for August 2026

The Sewer Authority Mid-Coastside (SAM) has prepared the following attached reports for the SAM Board of Directors and the California Regional Water Quality Control Board:

- Flow Report for August 2026
- Collection System Monthly Overflow Report August 2026

The average daily flow for Montara was 0.223 MGD in August 2026. There were 0 reportable overflows in August 2026 in the Montara System. SAM indicates there was 0.120 inches of rain in August 2026 in Montara.

RECOMMENDATION:

Review and File

Attachments

Sewer Authority Mid-Coastside

Monthly Collection System Activity/SSO Distribution Report, August 2026

August 2026

		Number of S.S.O's			
	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	0	0	0	0	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	0	0	0	0	0
Total	0	0	0	0	0

12 Month Moving Total

		12 month rolling Number			
	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	1	0	0	1	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	3	1	0	0	2
Total	4	1	0	1	2
		25%	0%	25%	50%

Reportable SSOs

		Reportable Number of S.S.O.'s			
	Total	HMB	GCSD	MWSD	SAM
August 2026	0	0	0	0	0
12 Month Moving Total	4	1	0	1	2

SSOs / Year / 100 Miles

		Number of S.S.O.'s /Year/100 Miles			
	Total	HMB	GCSD	MWSD	SAM
August 2026	0.0	0.0	0.0	0.0	0.0
12 Month Moving Total	3.8	2.7	0.0	3.7	27.4
Category 1	0.0	0.0	0.0	0.0	0.0
Category 2	0.0	0.0	0.0	0.0	0.0
Category 3	3.8	2.7	0.0	3.7	27.4
Category 4	0.0	0.0	0.0	0.0	0.0
Miles of Sewers	104.5	37.0	33.2	27.0	7.3
		35.4%	31.8%	25.8%	7.0%

12 Month Rolling Total Sewer Cleaning Summary


Month	HMB	GCSD	MWSD	Total Feet	Total Miles
Sep - 25	7,017	10,039	5,058	22,114	4.2
Oct - 25	14,567	9,753	9,098	33,418	6.3
Nov - 25	12,217	16,986	10,950	40,153	7.6
Dec - 25	0	9,235	8,160	17,395	3.3
Jan - 26	0	14,510	11,677	26,187	5.0
Feb - 26	11,310	13,557	6,858	31,725	6.0
Mar - 26	14,896	12,212	6,326	33,434	6.3
Apr - 26	12,430	14,599	6,635	33,664	6.4
May - 26	12,352	12,432	4,715	29,499	5.6
June - 26	5,532	9,140	7,123	21,795	4.1
July - 26	9,946	8,940	5,422	24,308	4.6
Aug - 26	10,806	8,007	8,530	27,343	5.2

Annual ft	111,073	139,410	90,552	341,035	
-----------	---------	---------	--------	---------	--

Annual Mi.	21.0	26.4	17.2		64.6
------------	------	------	------	--	------

Attachment C

12 Month Moving SSO Totals Through August 2026

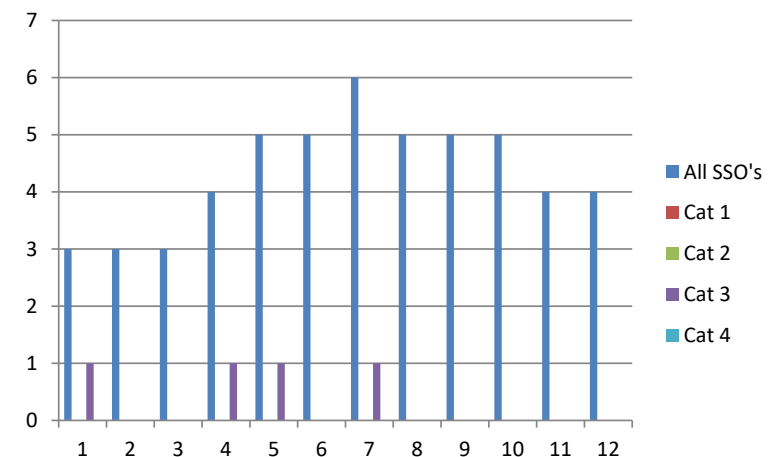

Attachment A


Flow Distribution Report Summary for August 2026

The daily flow report figures for the month of August 2026
have been converted to an Average

Daily Flow (ADF) for each Member Agency.
The results are attached for your review.

The summary of the ADF information is as follows:

	<u>MGD</u>	<u>%</u>
The City of Half Moon Bay	0.754	63.47%
Granada Community Services District	0.211	17.75%
Montara Water and Sanitary District	<u>0.223</u>	<u>18.78%</u>
Total	1.188	100.0%

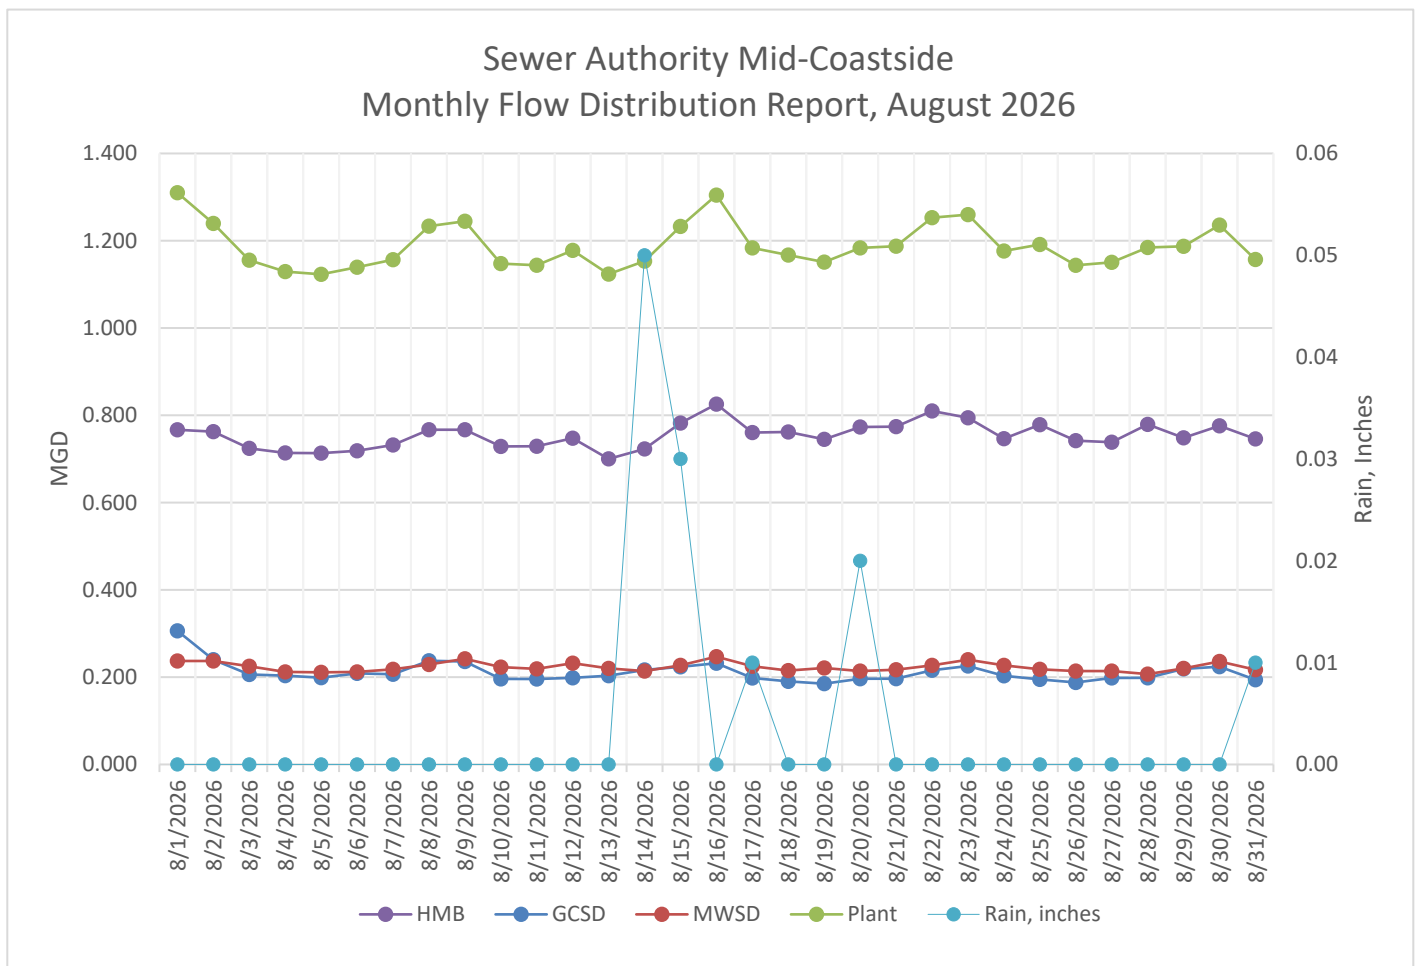

Sewer Authority Mid-Coastside


Monthly Flow Distribution Report for August 2026

<u>Date</u>	<u>HMB</u>	<u>GCSD</u>	<u>MWSD</u>	<u>Plant</u>	<u>Rain Plant</u>	<u>Rain Portola</u>	<u>Rain Montara</u>
8/1/2026	0.767	0.306	0.237	1.310	0.00	0.00	0.00
8/2/2026	0.763	0.240	0.237	1.240	0.00	0.00	0.00
8/3/2026	0.724	0.206	0.225	1.155	0.00	0.00	0.00
8/4/2026	0.714	0.203	0.212	1.129	0.00	0.00	0.00
8/5/2026	0.713	0.199	0.211	1.123	0.00	0.00	0.00
8/6/2026	0.719	0.209	0.212	1.139	0.00	0.00	0.00
8/7/2026	0.732	0.207	0.218	1.157	0.00	0.00	0.00
8/8/2026	0.767	0.238	0.229	1.233	0.00	0.00	0.00
8/9/2026	0.767	0.236	0.242	1.245	0.00	0.00	0.00
8/10/2026	0.729	0.196	0.223	1.148	0.00	0.00	0.00
8/11/2026	0.729	0.196	0.219	1.144	0.00	0.00	0.00
8/12/2026	0.748	0.198	0.232	1.178	0.00	0.00	0.00
8/13/2026	0.700	0.203	0.220	1.124	0.00	0.00	0.00
8/14/2026	0.723	0.216	0.214	1.153	0.05	0.02	0.04
8/15/2026	0.782	0.224	0.227	1.233	0.03	0.01	0.02
8/16/2026	0.826	0.232	0.247	1.305	0.00	0.00	0.00
8/17/2026	0.760	0.198	0.225	1.184	0.01	0.01	0.01
8/18/2026	0.762	0.190	0.215	1.167	0.00	0.00	0.01
8/19/2026	0.745	0.185	0.221	1.151	0.00	0.00	0.00
8/20/2026	0.773	0.196	0.214	1.183	0.02	0.01	0.02
8/21/2026	0.774	0.196	0.217	1.188	0.00	0.00	0.02
8/22/2026	0.810	0.216	0.227	1.253	0.00	0.00	0.00
8/23/2026	0.794	0.226	0.240	1.260	0.00	0.00	0.00
8/24/2026	0.746	0.203	0.227	1.176	0.00	0.00	0.00
8/25/2026	0.778	0.195	0.218	1.191	0.00	0.00	0.00
8/26/2026	0.742	0.188	0.214	1.144	0.00	0.00	0.00
8/27/2026	0.738	0.198	0.214	1.151	0.00	0.00	0.00
8/28/2026	0.779	0.198	0.207	1.185	0.00	0.00	0.00
8/29/2026	0.748	0.219	0.220	1.187	0.00	0.00	0.00
8/30/2026	0.776	0.224	0.236	1.236	0.00	0.00	0.00
8/31/2026	0.746	0.194	0.217	1.157	0.01	0.00	0.00
Totals	23.374	6.536	6.917	36.827	0.120	0.050	0.120


Summary

	<u>HMB</u>	<u>GCSD</u>	<u>MWSD</u>	<u>Plant</u>
Minimum	0.700	0.185	0.207	1.123
Average	0.754	0.211	0.223	1.188
Maximum	0.826	0.306	0.247	1.310
Distribution	63.47%	17.75%	18.78%	100.0%



Sewer Authority Mid-Coastside Monthly Flow Distribution Report, August 2026

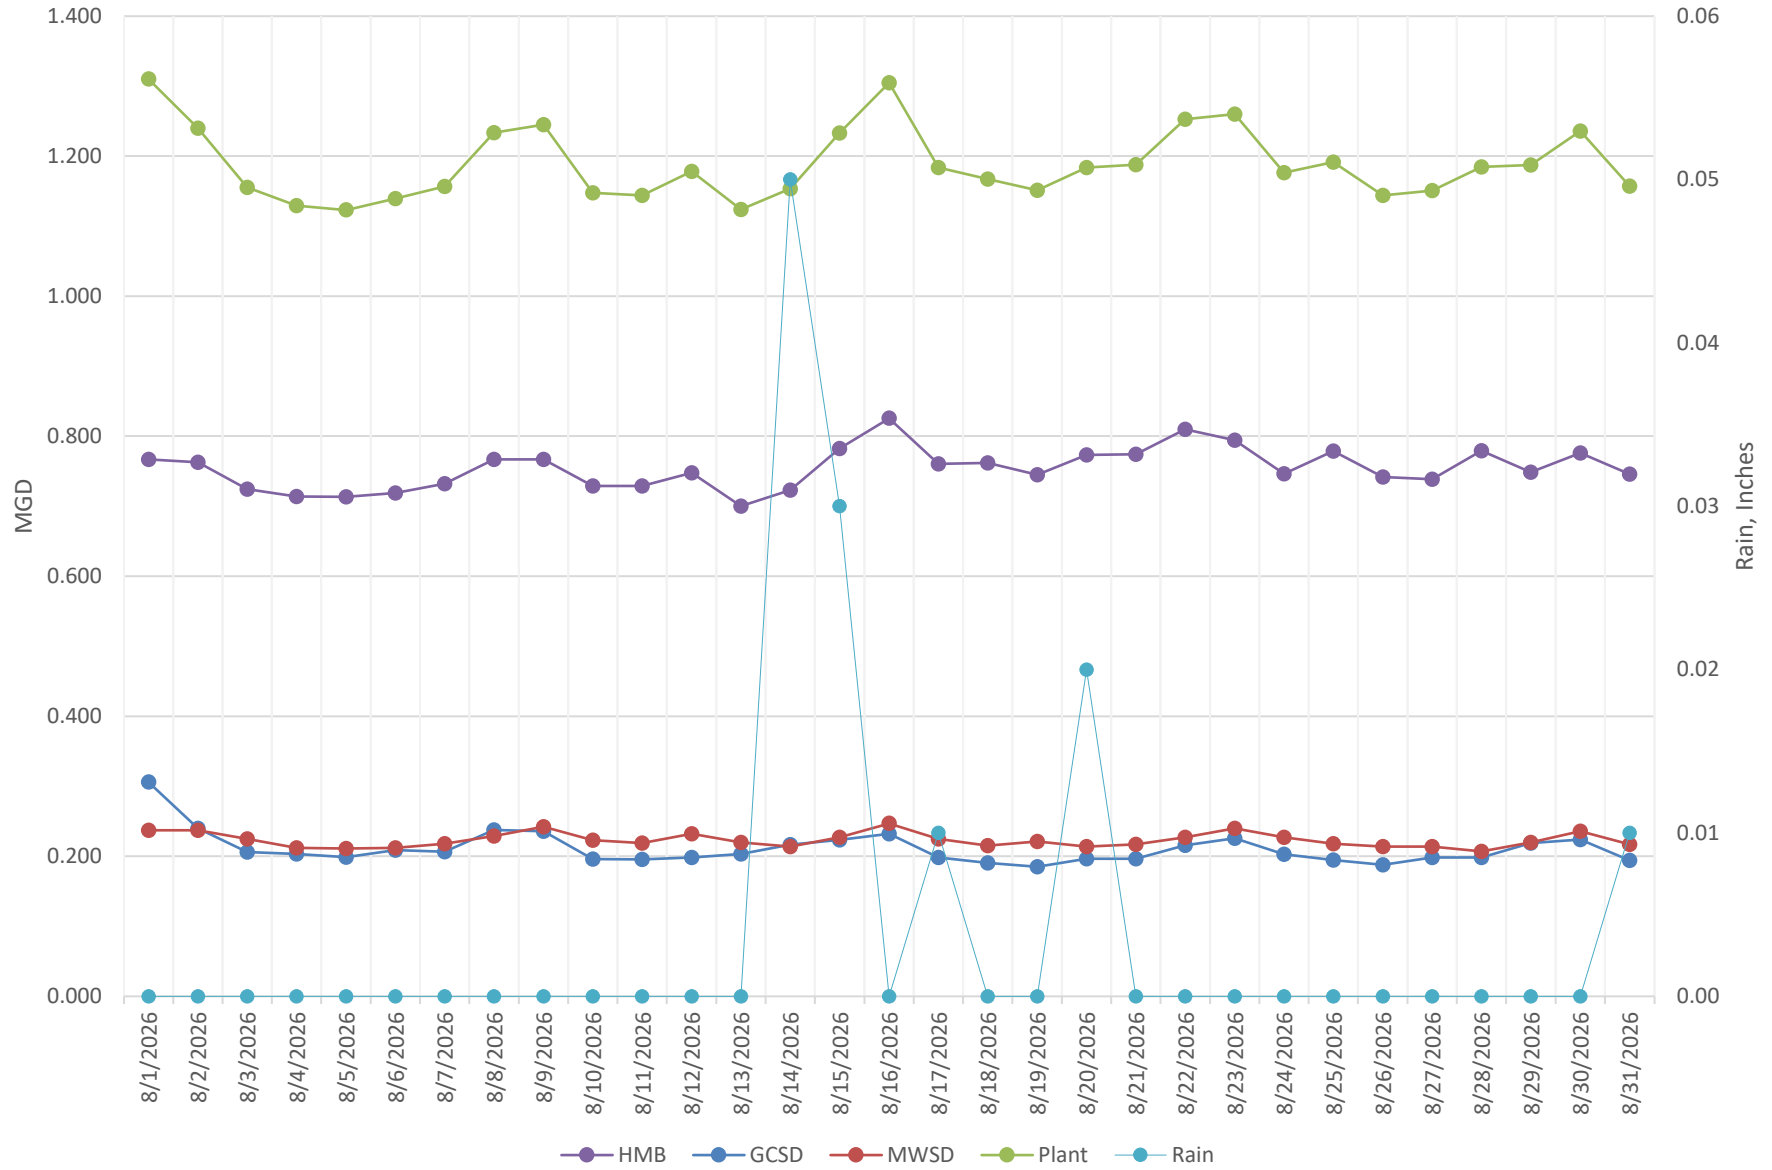

Percent Distribution August 2026

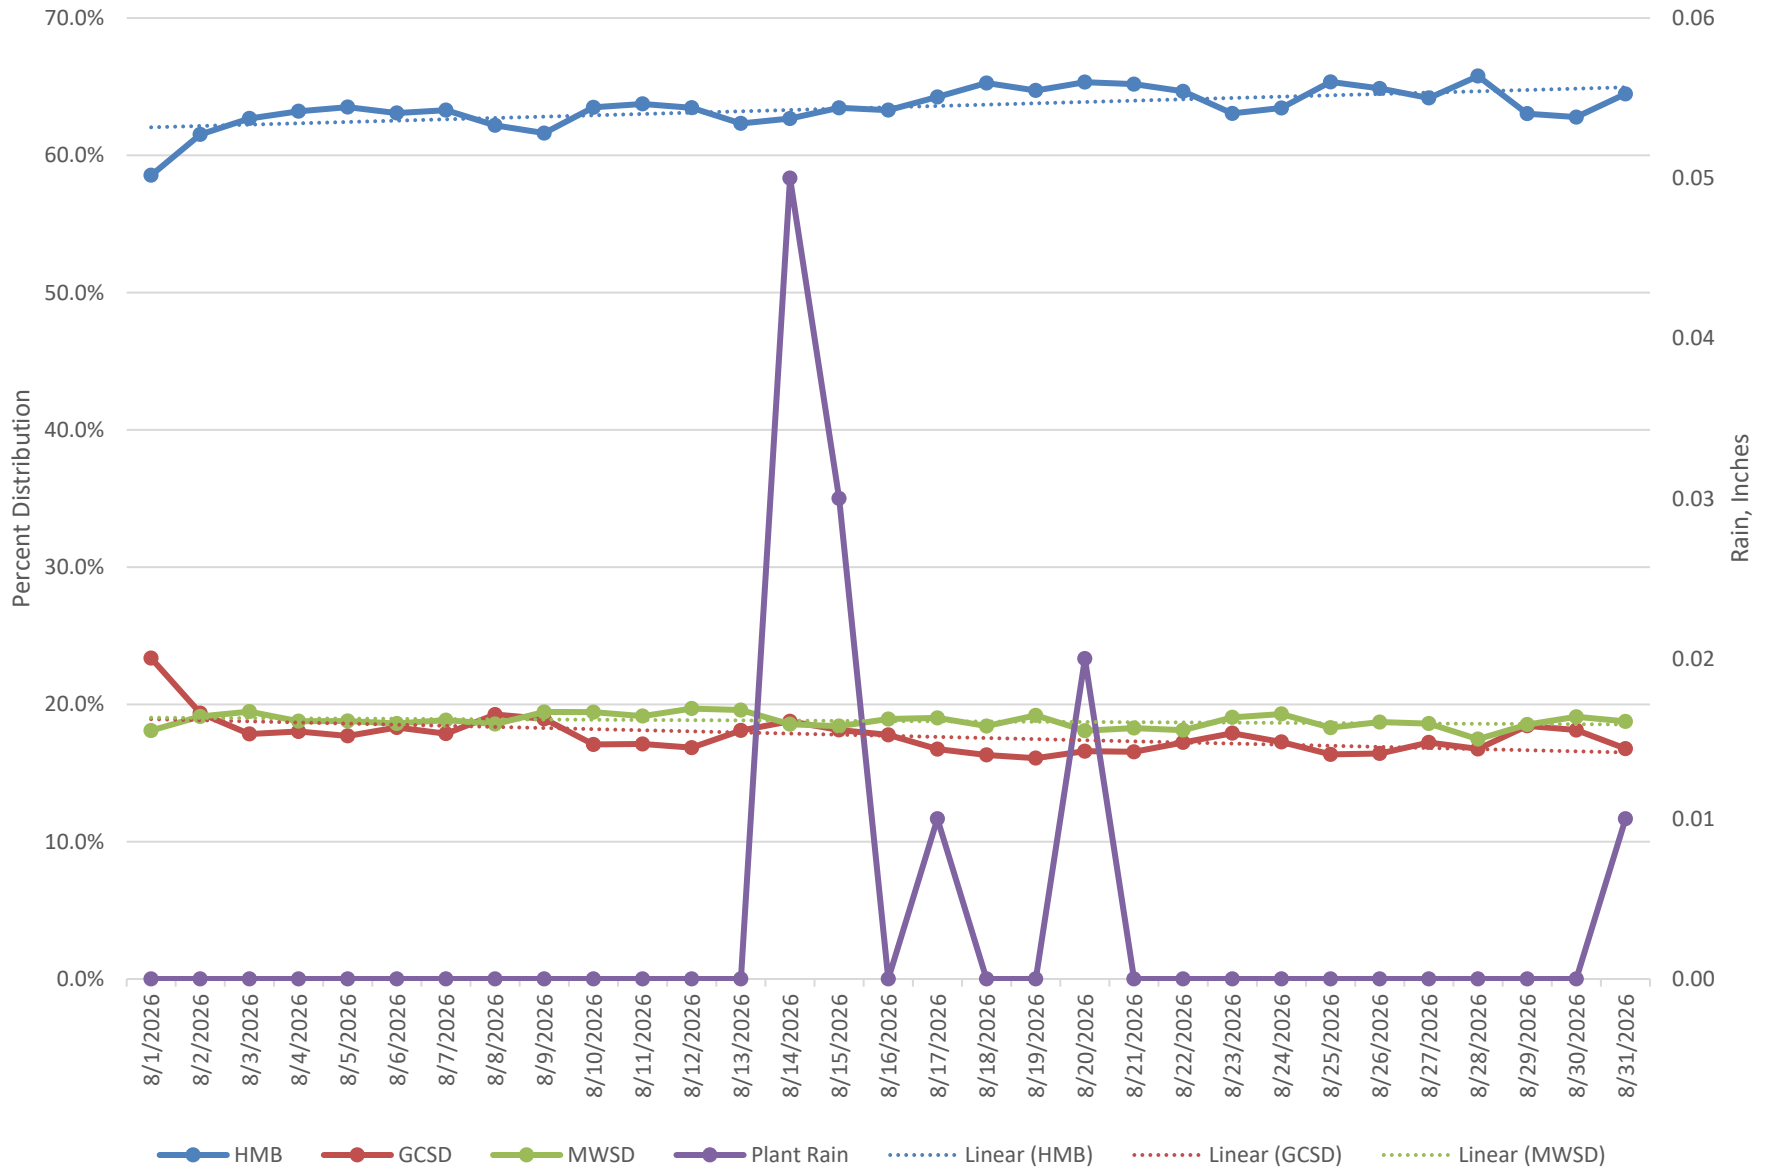

Most recent flow calibration January 2024 PS, June 2025 Plant inf

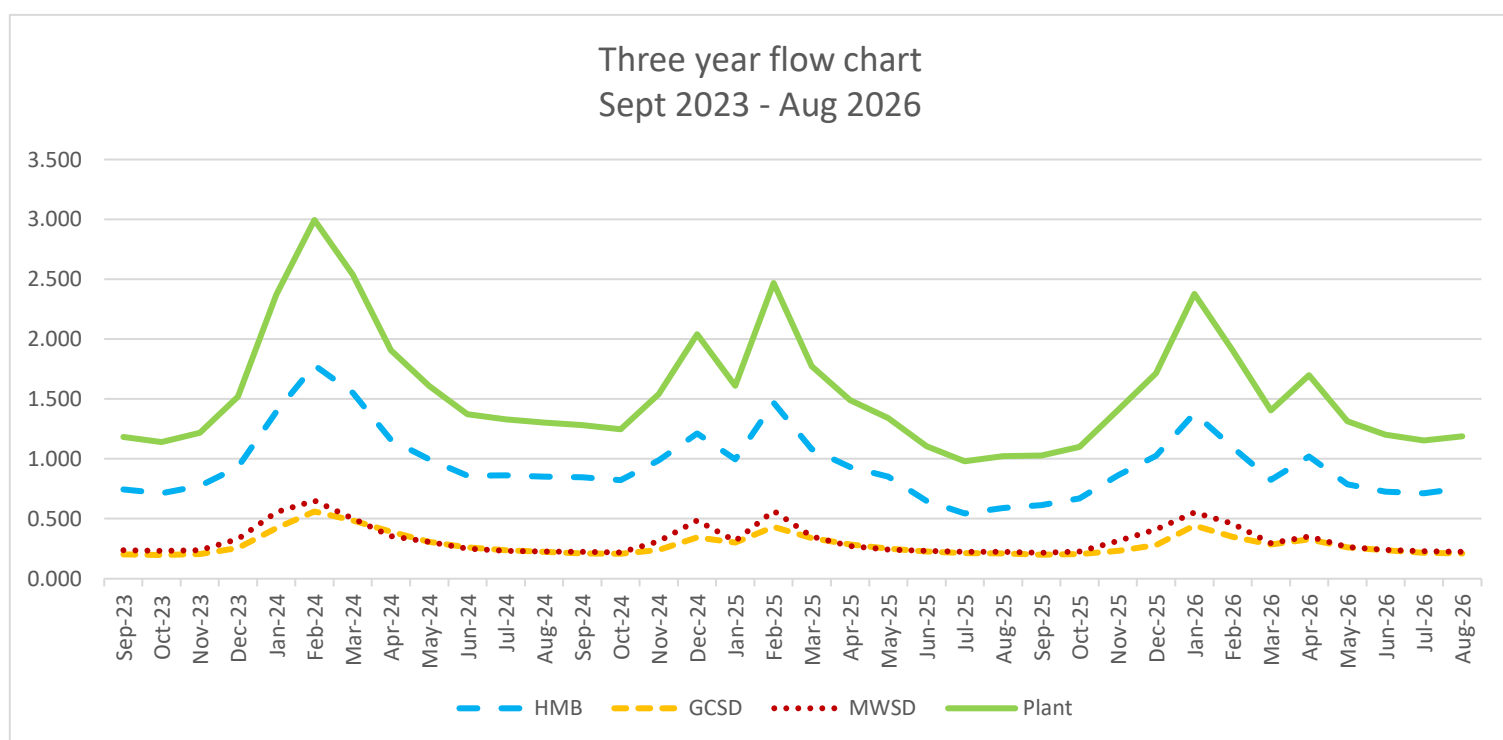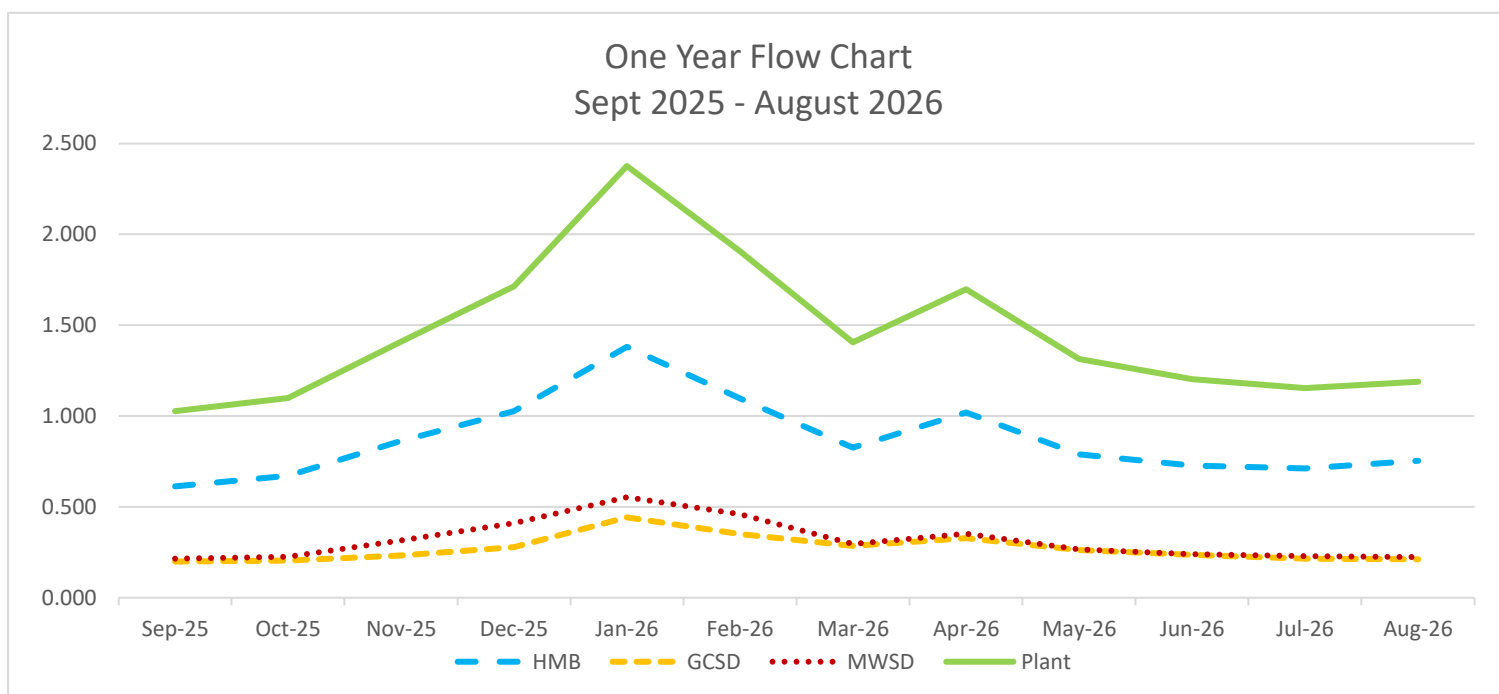

Flow based percent distribution based for past year

1 year Distribution by %
Sept 2025 - Aug 2026

