MONTARA WATER AND SANITARY DISTRICT AGENDA

Prepared for the Meeting Of: January 15, 2026

TO: BOARD OF DIRECTORS

FROM: Clemens H. Heldmaier, General Manager

SUBJECT: SAM Flow Report for October 2025

The Sewer Authority Mid-Coastside (SAM) has prepared the following attached reports for the SAM Board of Directors and the California Regional Water Quality Control Board:

- Flow Report for October 2025
- Collection System Monthly Overflow Report October 2025

The average daily flow for Montara was 0.225 MGD in October 2025. There were 0 reportable overflows in October 2025 in the Montara System. SAM indicates there was 1.650 inches of rain in October 2025 in Montara.

RECOMMENDATION:

Review and File

Attachments

Sewer Authority Mid-Coastside

Monthly Collection System Activity/SSO Distribution Report, October 2025

October 2025

Number of S.S.O's

	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	0	0	0	0	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	0	0	0	0	0
Total	**0**	**0**	**0**	**0**	**0**

12 Month Moving Total

12 month rolling Number

	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	1	0	0	1	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	2	0	0	1	1
Total	**3**	**0**	**0**	**2**	**1**
		0%	**0%**	**67%**	**33%**

Reportable SSOs

Reportable Number of S.S.O.'s

	Total	HMB	GCSD	MWSD	SAM
October 2025	0	0	0	0	0
12 Month Moving Total	3	0	0	2	1

SSOs / Year / 100 Miles

Number of S.S.O.'s /Year/100 Miles

	Total	HMB	GCSD	MWSD	SAM
October 2025	0.0	0.0	0.0	0.0	0.0
12 Month Moving Total	2.9	0.0	0.0	7.4	13.7
Category 1	0.0	0.0	0.0	0.0	0.0
Category 2	0.0	0.0	0.0	0.0	0.0
Category 3	1.9	0.0	0.0	3.7	13.7
Category 4	1.0	0.0	0.0	3.7	0.0
Miles of Sewers	104.5	37.0	33.2	27.0	7.3
		35.4%	31.8%	25.8%	7.0%

12 Month Rolling Total Sewer Cleaning Summary

Month	HMB	GCSD	MWSD	Total Feet	Total Miles
Nov - 24	12,497	13,252	10,026	35,775	6.8
Dec - 24	11,178	15,168	4,120	30,466	5.8
Jan - 25	6,789	12,256	9,935	28,980	5.5
Feb - 25	13,501	11,719	7,630	32,850	6.2
Mar - 25	6,257	14,540	10,183	30,980	5.9
Apr - 25	15,622	12,056	7,275	34,953	6.6
May - 25	7,166	11,010	6,516	24,692	4.7
June - 25	19,379	9,910	5,769	35,058	6.6
July - 25	4,613	9,598	5,225	19,436	3.7
Aug - 25	9,341	9,394	9,223	27,958	5.3
Sep - 25	7,017	10,039	5,058	22,114	4.2
Oct - 25	14,567	9,753	9,098	33,418	6.3
Annual ft	127,927	138,695	90,058	356,680	
Annual Mi.	24.2	26.3	17.1		67.6

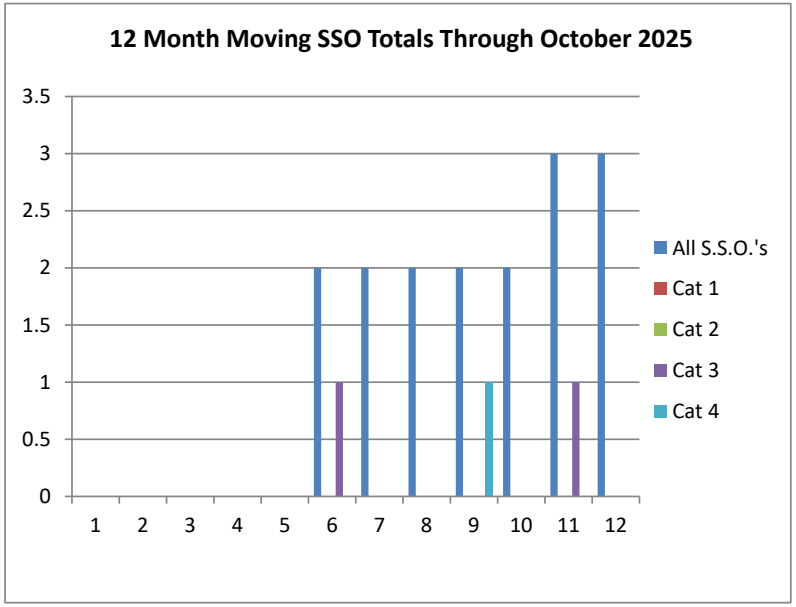

Attachment C

Attachment A

Flow Distribution Report Summary for October 2025

The daily flow report figures for the month of October 2025
have been converted to an Average

Daily Flow (ADF) for each Member Agency.
The results are attached for your review.

The summary of the ADF information is as follows:

	MGD	%
The City of Half Moon Bay	0.799	65.05%
Granada Community Services District	0.204	16.61%
Montara Water and Sanitary District	0.225	18.34%
Total	1.228	100.0%

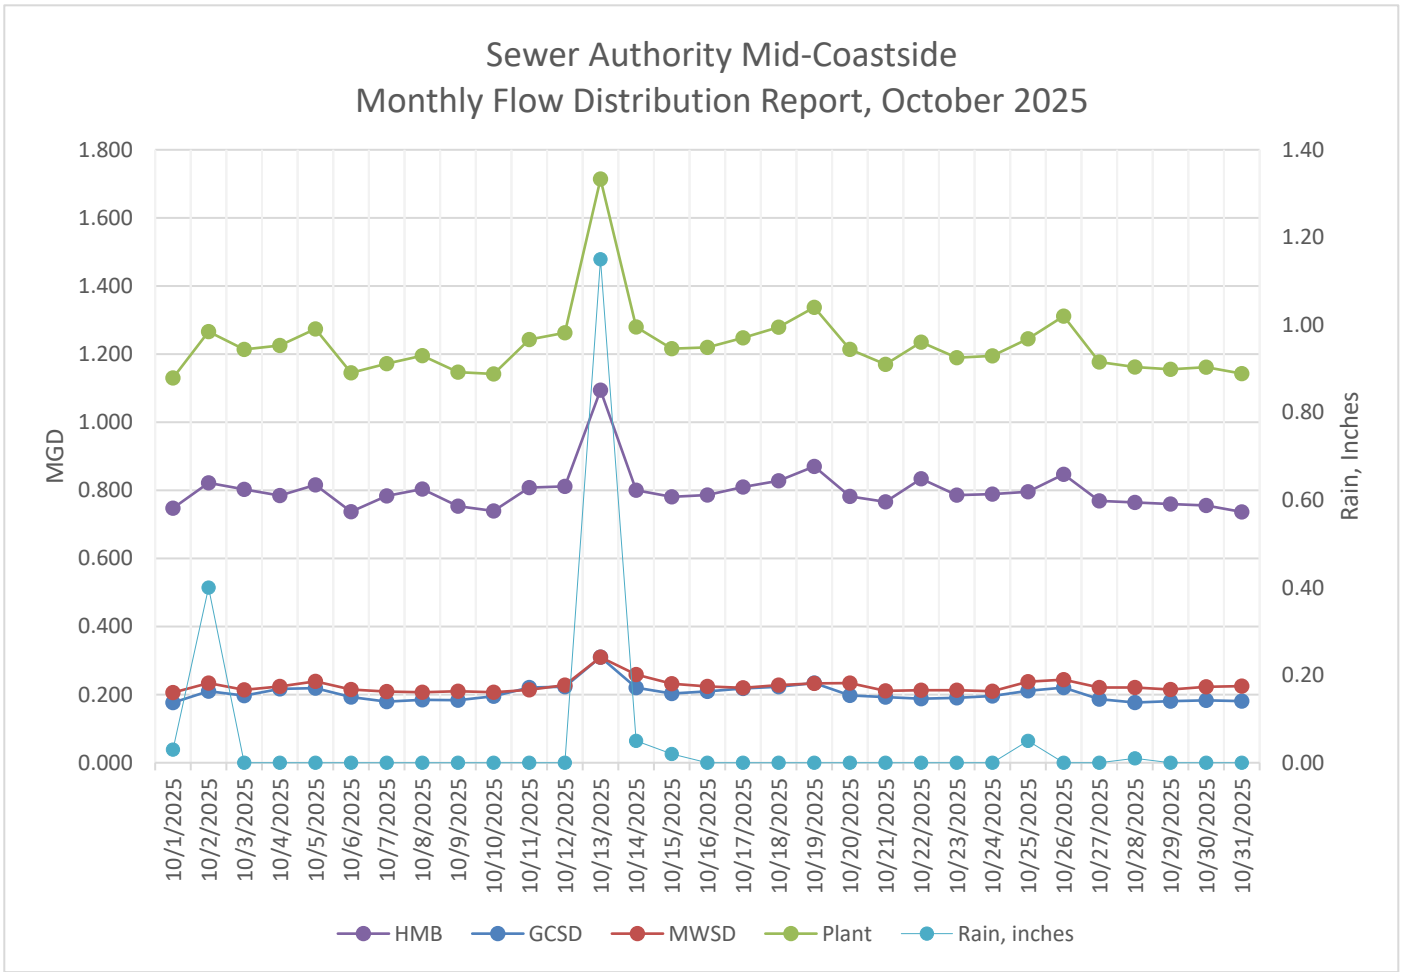

Sewer Authority Mid-Coastside

Monthly Flow Distribution Report for October 2025

Date	HMB	GCSD	MWSD	Plant	Rain Plant	Rain Portola	Rain Montara
10/1/2025	0.747	0.177	0.206	1.130	0.03	0.03	0.06
10/2/2025	0.822	0.210	0.234	1.266	0.40	0.23	0.36
10/3/2025	0.803	0.197	0.214	1.214	0.00	0.00	0.00
10/4/2025	0.785	0.217	0.224	1.225	0.00	0.00	0.00
10/5/2025	0.816	0.219	0.239	1.274	0.00	0.00	0.00
10/6/2025	0.737	0.193	0.215	1.145	0.00	0.00	0.00
10/7/2025	0.784	0.179	0.209	1.172	0.00	0.00	0.00
10/8/2025	0.804	0.185	0.207	1.195	0.00	0.00	0.00
10/9/2025	0.753	0.184	0.210	1.147	0.00	0.00	0.00
10/10/2025	0.739	0.195	0.207	1.142	0.00	0.00	0.00
10/11/2025	0.808	0.221	0.214	1.243	0.00	0.00	0.00
10/12/2025	0.812	0.223	0.228	1.263	0.00	0.00	0.00
10/13/2025	1.094	0.310	0.310	1.714	1.15	2.00	1.03
10/14/2025	0.800	0.220	0.259	1.280	0.05	0.05	0.01
10/15/2025	0.781	0.203	0.232	1.216	0.02	0.04	0.02
10/16/2025	0.786	0.210	0.224	1.220	0.00	0.00	0.00
10/17/2025	0.810	0.218	0.220	1.248	0.00	0.00	0.00
10/18/2025	0.828	0.223	0.228	1.279	0.00	0.00	0.00
10/19/2025	0.870	0.234	0.233	1.337	0.00	0.00	0.00
10/20/2025	0.782	0.198	0.234	1.214	0.00	0.00	0.00
10/21/2025	0.766	0.193	0.211	1.170	0.00	0.00	0.00
10/22/2025	0.834	0.188	0.213	1.235	0.00	0.00	0.00
10/23/2025	0.786	0.191	0.213	1.189	0.00	0.00	0.00
10/24/2025	0.789	0.196	0.210	1.195	0.00	0.00	0.00
10/25/2025	0.796	0.211	0.238	1.245	0.05	0.05	0.13
10/26/2025	0.847	0.221	0.244	1.312	0.00	0.00	0.04
10/27/2025	0.769	0.187	0.221	1.177	0.00	0.00	0.00
10/28/2025	0.764	0.177	0.221	1.162	0.01	0.00	0.00
10/29/2025	0.760	0.181	0.215	1.155	0.00	0.00	0.00
10/30/2025	0.755	0.183	0.223	1.162	0.00	0.00	0.00
10/31/2025	0.737	0.181	0.225	1.143	0.00	0.00	0.00
Totals	**24.763**	**6.323**	**6.981**	**38.067**	**1.710**	**2.400**	**1.650**

Summary

	HMB	GCSD	MWSD	Plant
Minimum	0.737	0.177	0.206	1.130
Average	**0.799**	**0.204**	**0.225**	**1.228**
Maximum	1.094	0.310	0.310	1.714
Distribution	**65.05%**	**16.61%**	**18.34%**	**100.0%**

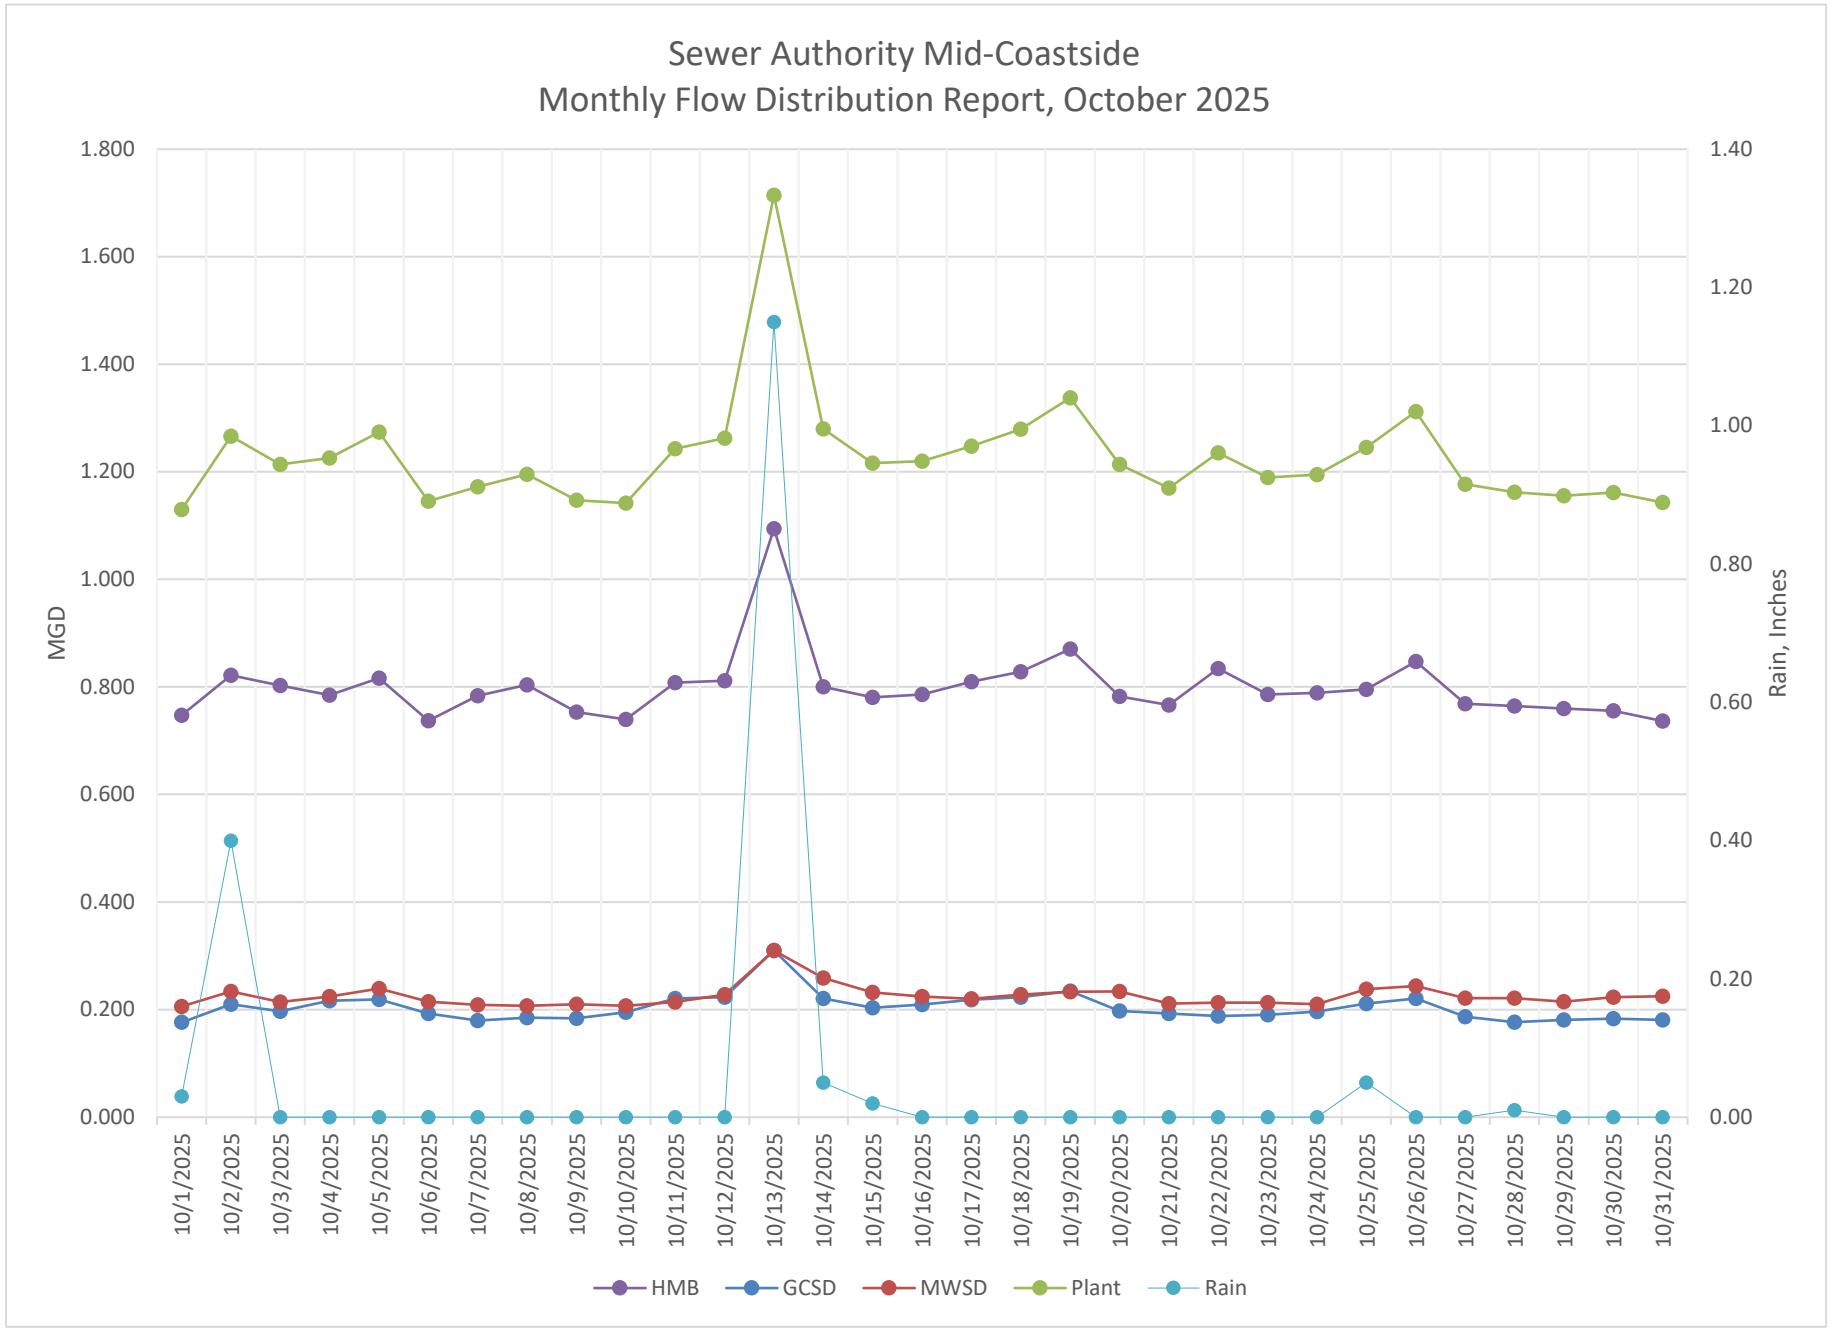
Sewer Authority Mid-Coastside
Monthly Flow Distribution Report, October 2025
MGD
Rain, Inches
1.800
1.600
1.400
1.200
1.000
0.800
0.600
0.400
0.200
0.000
1.40
1.20
1.00
0.80
0.60
0.40
0.20
0.00
10/1/2025
10/2/2025
10/3/2025
10/4/2025
10/5/2025
10/6/2025
10/7/2025
10/8/2025
10/9/2025
10/10/2025
10/11/2025
10/12/2025
10/13/2025
10/14/2025
10/15/2025
10/16/2025
10/17/2025
10/18/2025
10/19/2025
10/20/2025
10/21/2025
10/22/2025
10/23/2025
10/24/2025
10/25/2025
10/26/2025
10/27/2025
10/28/2025
10/29/2025
10/30/2025
10/31/2025
HMB
GCSD
MWSD
Plant
Rain

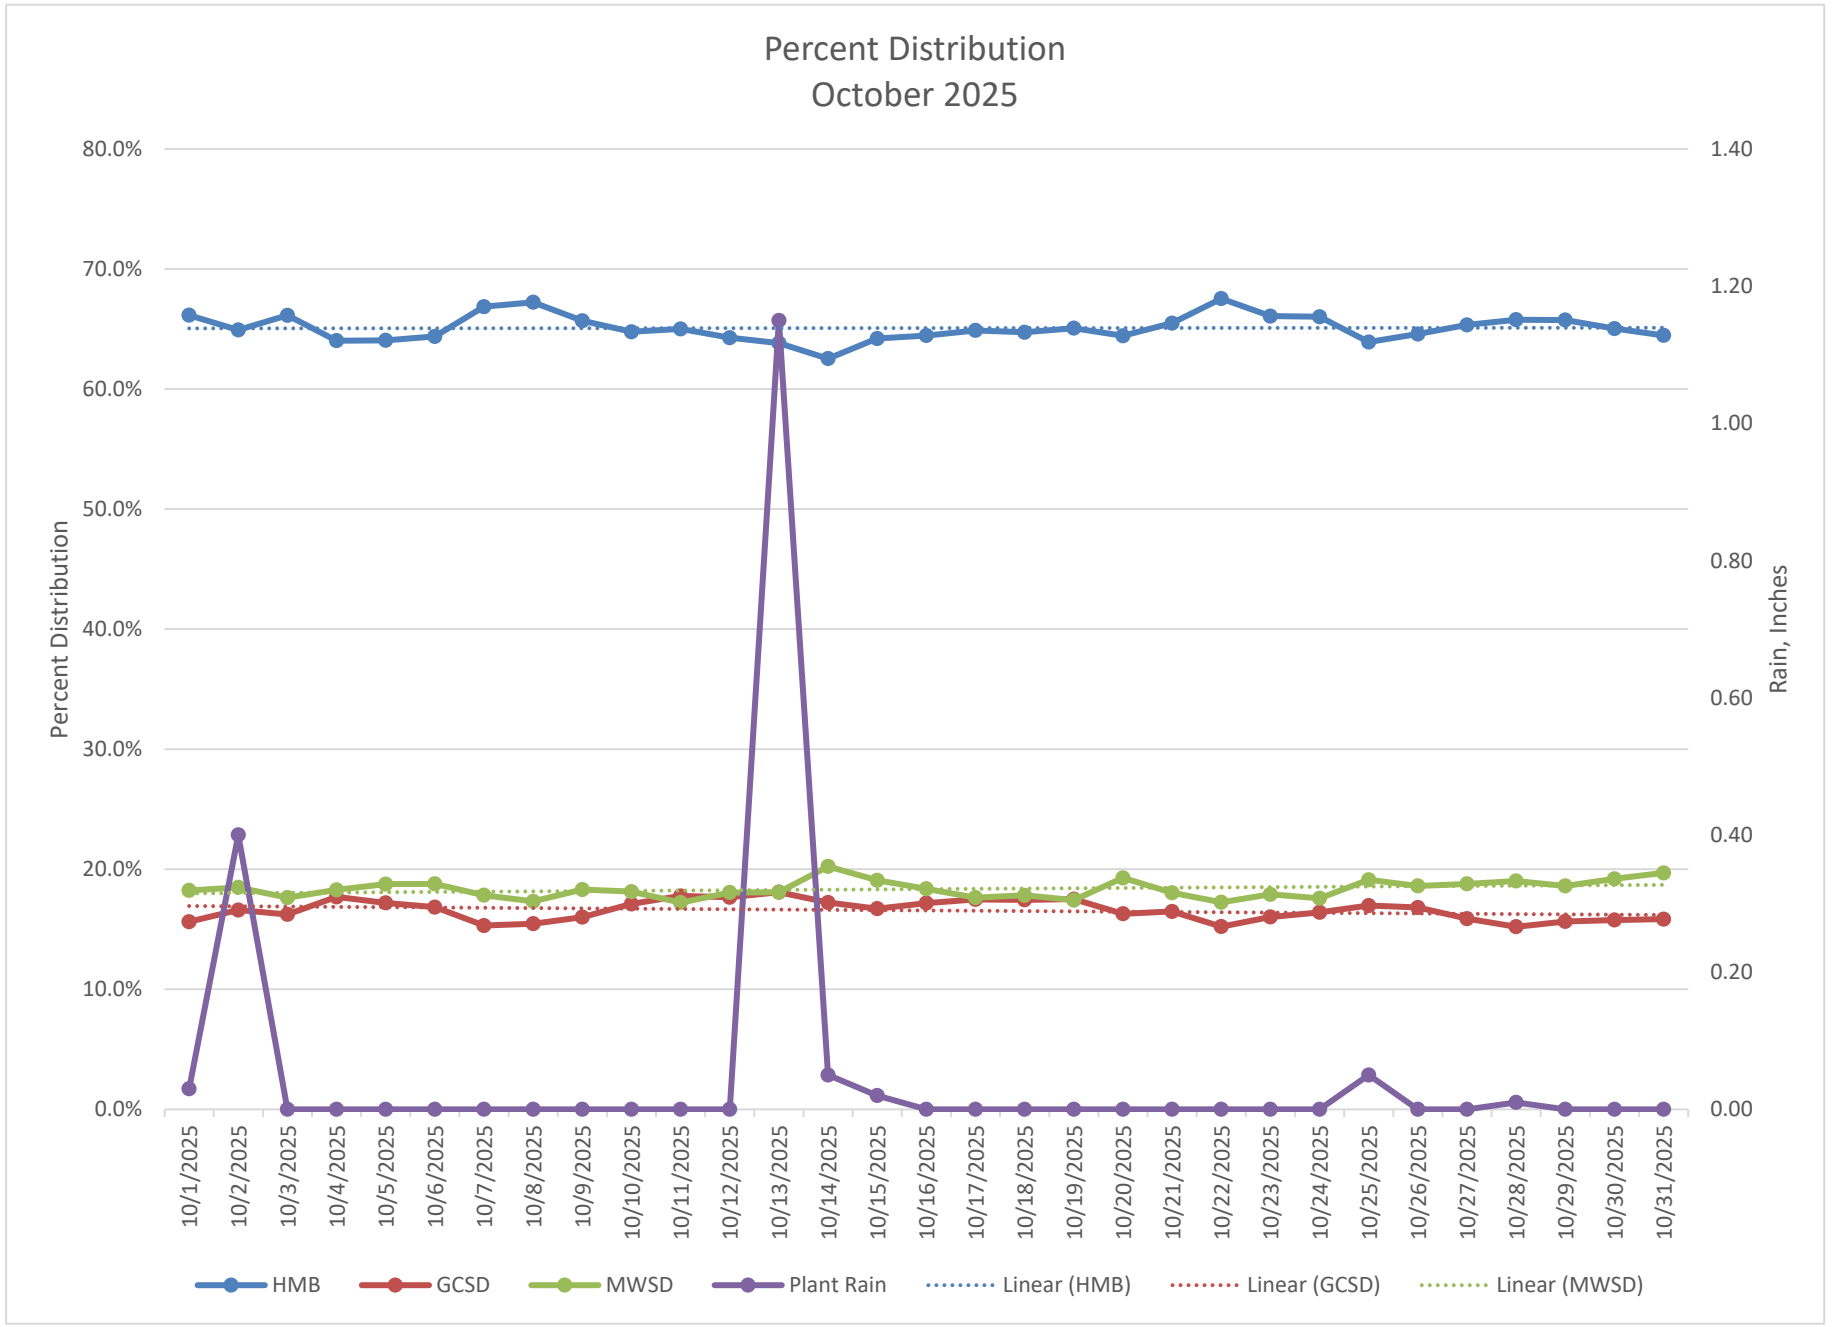
Percent Distribution
October 2025
Percent Distribution
Rain, Inches
80.0%
70.0%
60.0%
50.0%
40.0%
30.0%
20.0%
10.0%
0.0%
1.40
1.20
1.00
0.80
0.60
0.40
0.20
0.00
10/1/2025
10/2/2025
10/3/2025
10/4/2025
10/5/2025
10/6/2025
10/7/2025
10/8/2025
10/9/2025
10/10/2025
10/11/2025
10/12/2025
10/13/2025
10/14/2025
10/15/2025
10/16/2025
10/17/2025
10/18/2025
10/19/2025
10/20/2025
10/21/2025
10/22/2025
10/23/2025
10/24/2025
10/25/2025
10/26/2025
10/27/2025
10/28/2025
10/29/2025
10/30/2025
10/31/2025
HMB
GCSD
MWSD
Plant Rain
Linear (HMB)
Linear (GCSD)
Linear (MWSD)

Most recent flow calibration January 2024 PS, June 2025 Plant inf

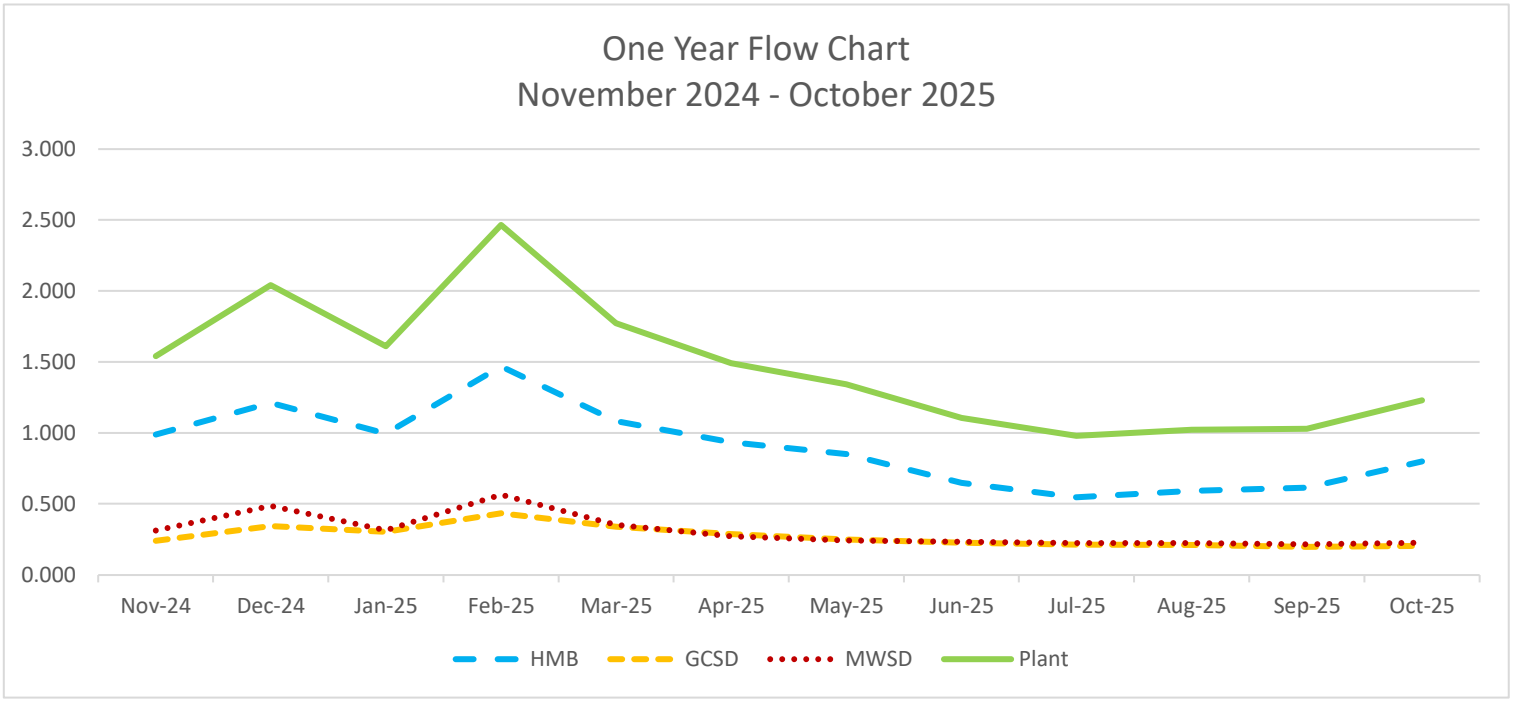

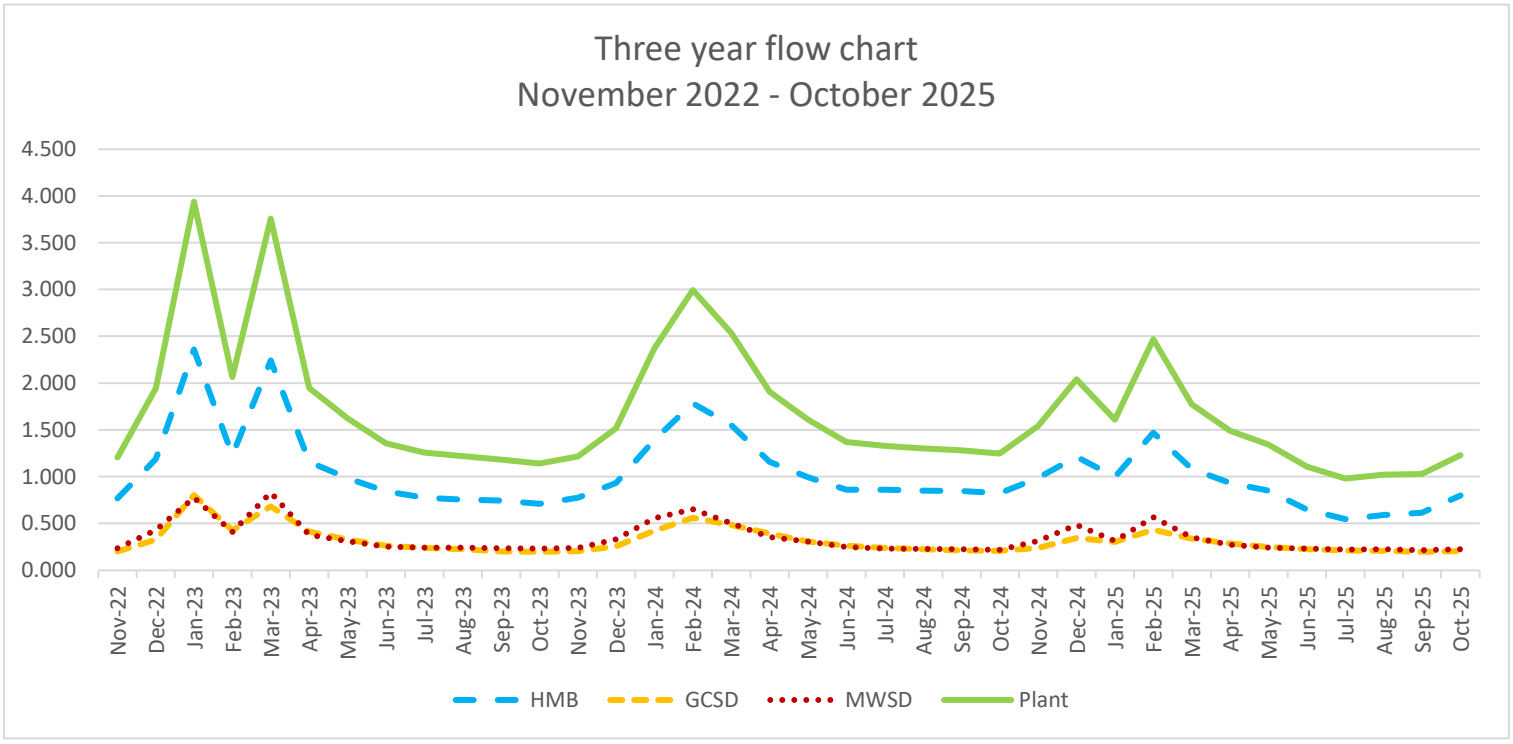
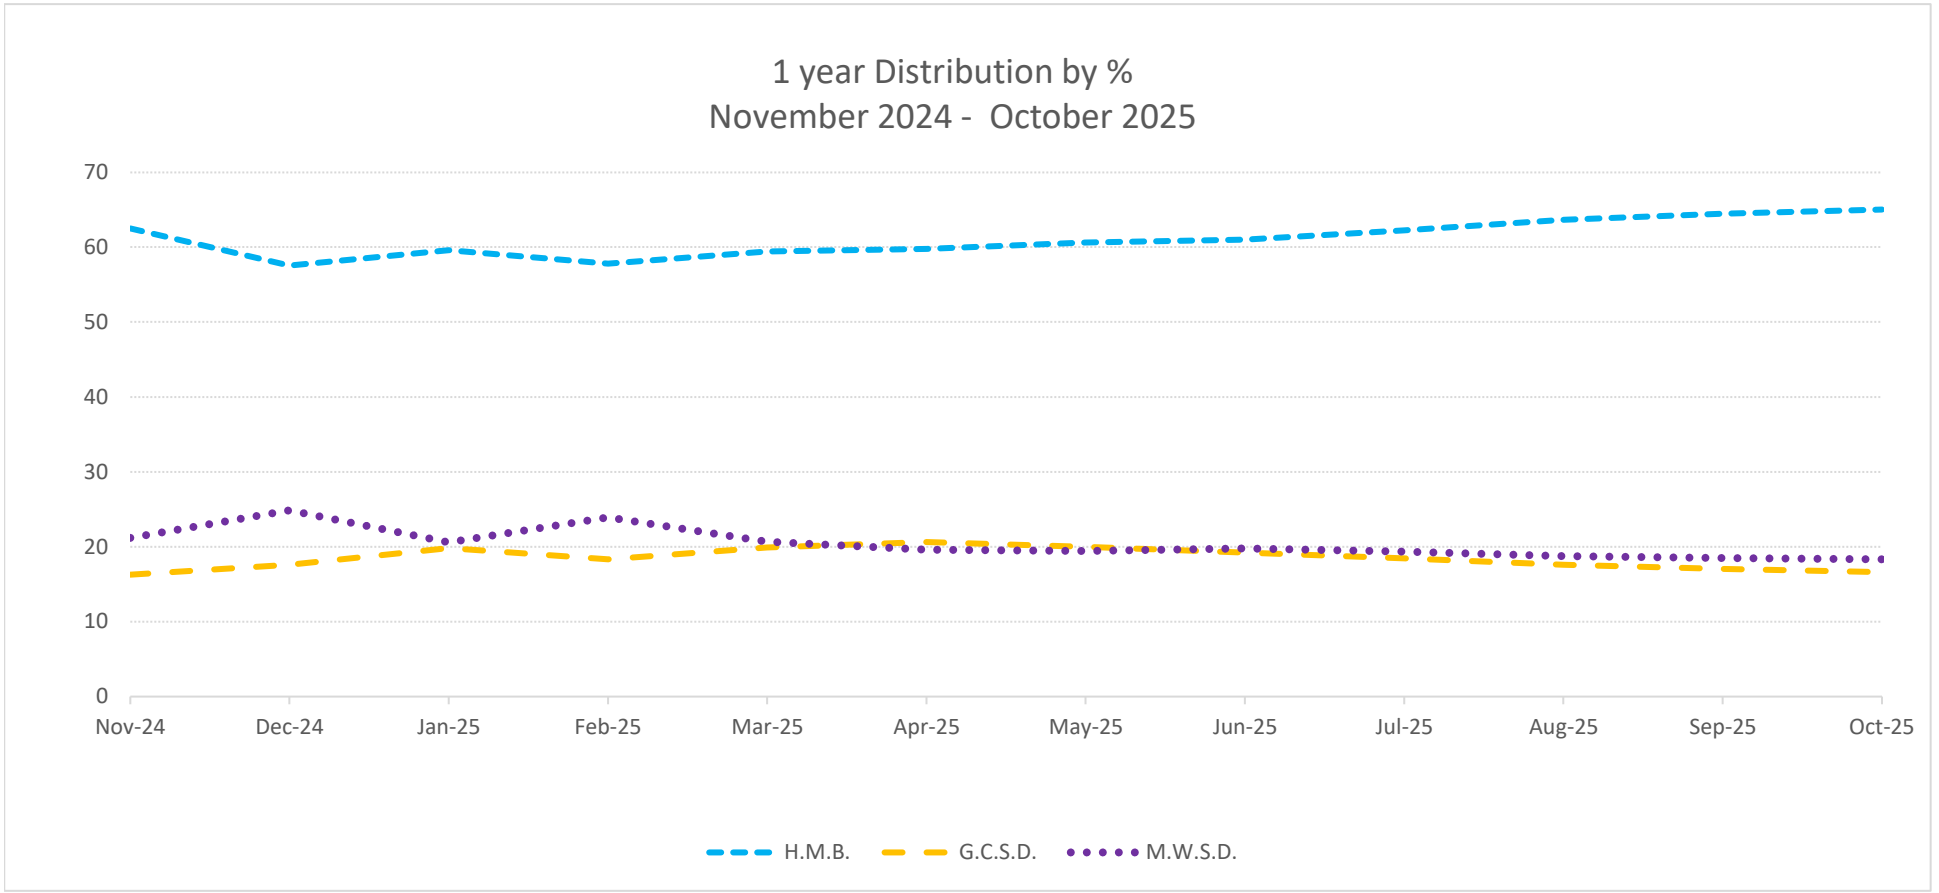
Flow based percent distribution based for past year