MONTARA WATER AND SANITARY DISTRICT AGENDA

Prepared for the Meeting Of: November 19, 2026

TO: BOARD OF DIRECTORS

FROM: Clemens H. Heldmaier, General Manager

SUBJECT: SAM Flow Report for September 2026

The Sewer Authority Mid-Coastside (SAM) has prepared the following attached reports for the SAM Board of Directors and the California Regional Water Quality Control Board:

- Flow Report for September 2026
- Collection System Monthly Overflow Report September 2026

The average daily flow for Montara was 0.221 MGD in September 2026. There were 0 reportable overflows in September 2026 in the Montara System. SAM indicates there was 0.190 inches of rain in September 2026 in Montara.

RECOMMENDATION:

Review and File

Attachments

Sewer Authority Mid-Coastside

Monthly Collection System Activity/SSO Distribution Report, September 2026

September 2026

Number of S.S.O's

	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	0	0	0	0	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	0	0	0	0	0
Total	**0**	**0**	**0**	**0**	**0**

12 Month Moving Total

12 month rolling Number

	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	0	0	0	0	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	3	1	0	0	2
Total	**3**	**1**	**0**	**0**	**2**
		33%	**0%**	**0%**	**67%**

Reportable SSOs

Reportable Number of S.S.O.'s

	Total	HMB	GCSD	MWSD	SAM
September 2026	0	0	0	0	0
12 Month Moving Total	3	1	0	0	2


SSOs / Year / 100 Miles

Number of S.S.O.'s /Year/100 Miles

	Total	HMB	GCSD	MWSD	SAM
September 2026	0.0	0.0	0.0	0.0	0.0
12 Month Moving Total	2.9	2.7	0.0	0.0	27.4
Category 1	0.0	0.0	0.0	0.0	0.0
Category 2	0.0	0.0	0.0	0.0	0.0
Category 3	2.9	2.7	0.0	0.0	27.4
Category 4	0.0	0.0	0.0	0.0	0.0
Miles of Sewers	104.5	37.0	33.2	27.0	7.3
		35.4%	31.8%	25.8%	7.0%

12 Month Rolling Total Sewer Cleaning Summary

Month	HMB	GCSD	MWSD	Total Feet	Total Miles
Oct - 25	14,567	9,753	9,098	33,418	6.3
Nov - 25	12,217	16,986	10,950	40,153	7.6
Dec - 25	0	9,235	8,160	17,395	3.3
Jan - 26	0	14,510	11,677	26,187	5.0
Feb - 26	11,310	13,557	6,858	31,725	6.0
Mar - 26	14,896	12,212	6,326	33,434	6.3
Apr - 26	12,430	14,599	6,635	33,664	6.4
May - 26	12,352	12,432	4,715	29,499	5.6
June - 26	5,532	9,140	7,123	21,795	4.1
July - 26	9,946	8,940	5,422	24,308	4.6
Aug - 26	10,806	8,007	8,530	27,343	5.2
Sept - 26	6,186	10,353	7,919	24,458	4.6
Annual ft	110,242	139,724	93,413	343,379	
Annual Mi.	20.9	26.5	17.7		65.0

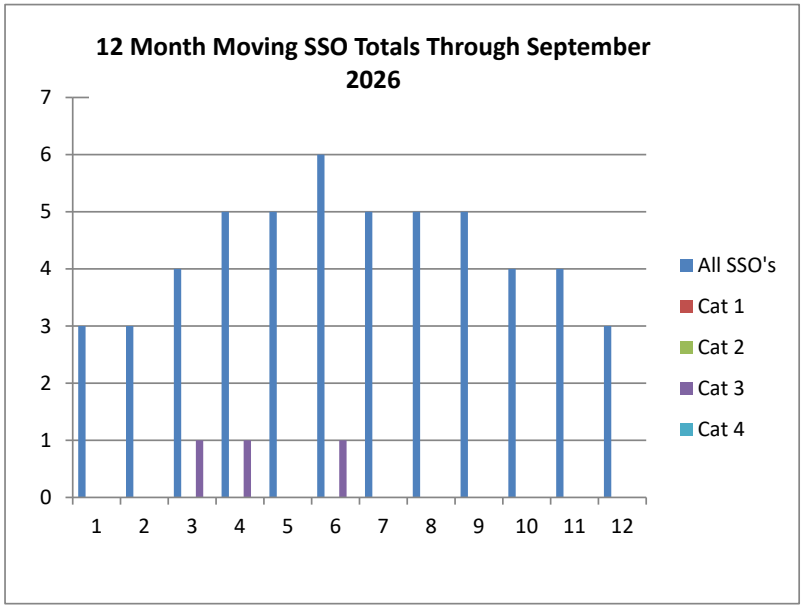

Attachment C

Attachment A


Flow Distribution Report Summary for September 2026

The daily flow report figures for the month of September 2026
have been converted to an Average

Daily Flow (ADF) for each Member Agency.
The results are attached for your review.

The summary of the ADF information is as follows:

	MGD	%
The City of Half Moon Bay	0.771	64.99%
Granada Community Services District	0.195	16.42%
Montara Water and Sanitary District	0.221	18.59%
Total	1.187	100.0%

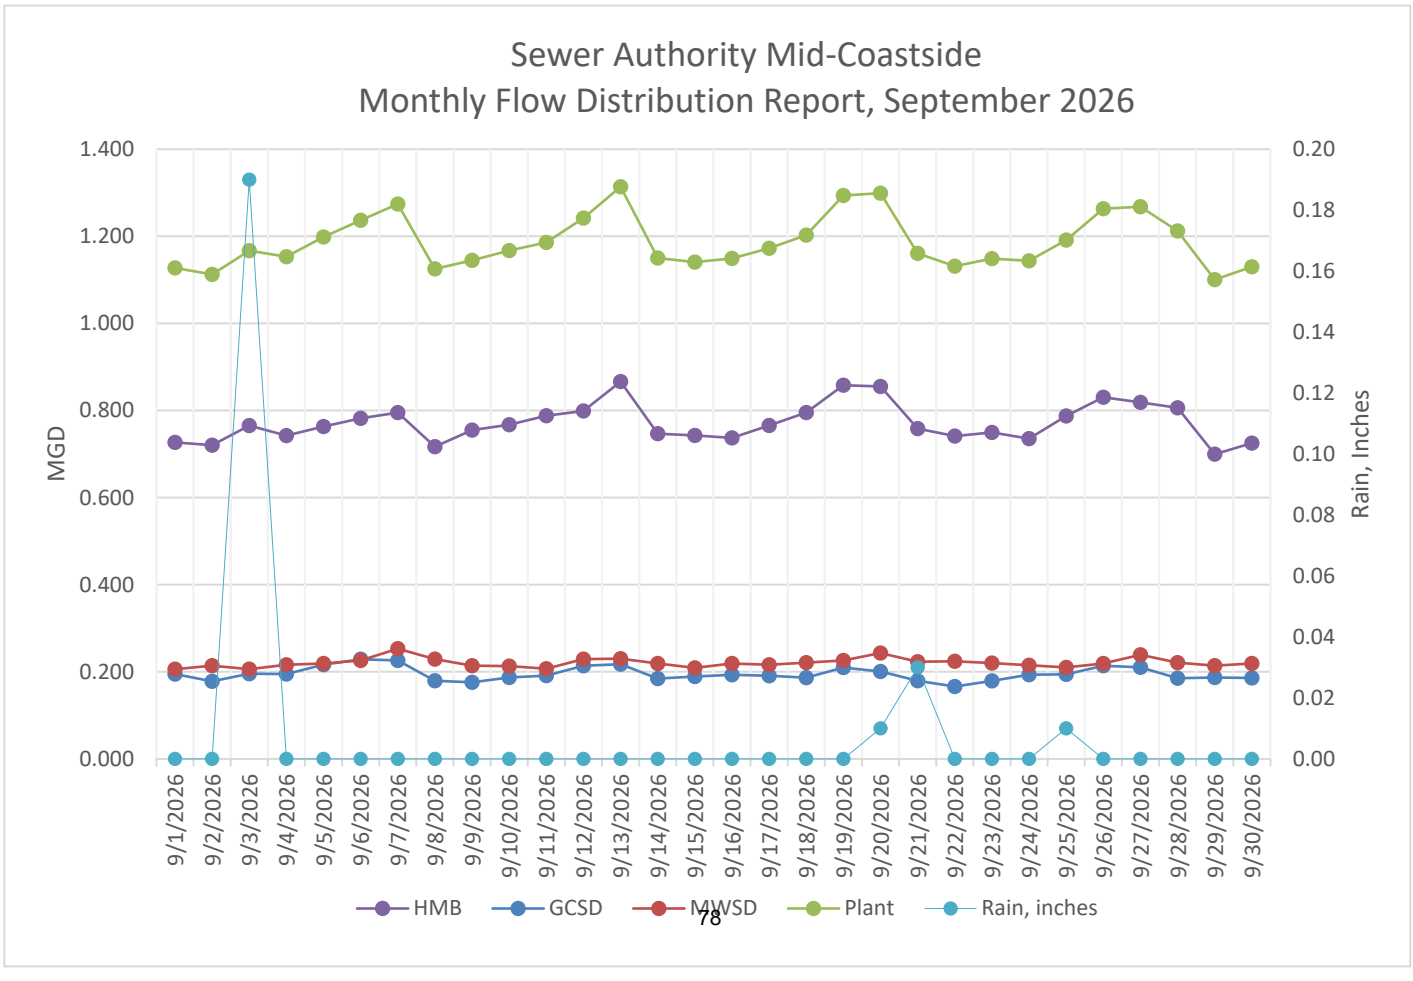


Sewer Authority Mid-Coastside


Monthly Flow Distribution Report for September 2026

Date	HMB	GCSD	MWSD	Plant	Rain Plant	Rain Portola	Rain Montara
9/1/2026	0.727	0.195	0.206	1.127	0.00	0.00	0.00
9/2/2026	0.720	0.178	0.214	1.112	0.00	0.00	0.00
9/3/2026	0.765	0.196	0.206	1.167	0.19	0.12	0.14
9/4/2026	0.742	0.195	0.216	1.153	0.00	0.00	0.00
9/5/2026	0.763	0.216	0.219	1.198	0.00	0.00	0.00
9/6/2026	0.782	0.229	0.226	1.237	0.00	0.00	0.00
9/7/2026	0.795	0.226	0.253	1.274	0.00	0.00	0.00
9/8/2026	0.717	0.179	0.229	1.125	0.00	0.00	0.00
9/9/2026	0.755	0.176	0.214	1.145	0.00	0.00	0.00
9/10/2026	0.767	0.187	0.213	1.167	0.00	0.00	0.00
9/11/2026	0.788	0.191	0.207	1.186	0.00	0.00	0.00
9/12/2026	0.799	0.214	0.229	1.242	0.00	0.00	0.00
9/13/2026	0.866	0.217	0.230	1.314	0.00	0.00	0.00
9/14/2026	0.747	0.184	0.219	1.150	0.00	0.00	0.00
9/15/2026	0.743	0.189	0.209	1.141	0.00	0.00	0.00
9/16/2026	0.737	0.193	0.219	1.149	0.00	0.00	0.00
9/17/2026	0.766	0.191	0.216	1.172	0.00	0.00	0.00
9/18/2026	0.795	0.186	0.221	1.203	0.00	0.00	0.00
9/19/2026	0.858	0.210	0.226	1.294	0.00	0.00	0.00
9/20/2026	0.855	0.201	0.243	1.299	0.01	0.01	0.01
9/21/2026	0.758	0.179	0.223	1.161	0.03	0.02	0.01
9/22/2026	0.741	0.166	0.224	1.131	0.00	0.01	0.00
9/23/2026	0.750	0.179	0.220	1.149	0.00	0.00	0.00
9/24/2026	0.735	0.193	0.215	1.144	0.00	0.00	0.00
9/25/2026	0.787	0.194	0.210	1.191	0.01	0.03	0.03
9/26/2026	0.830	0.214	0.219	1.263	0.00	0.00	0.00
9/27/2026	0.819	0.210	0.239	1.268	0.00	0.00	0.00
9/28/2026	0.806	0.185	0.221	1.212	0.00	0.00	0.00
9/29/2026	0.700	0.187	0.214	1.100	0.00	0.00	0.00
9/30/2026	0.725	0.186	0.219	1.130	0.00	0.00	0.00
Totals	**23.138**	**5.846**	**6.619**	**35.603**	**0.240**	**0.190**	**0.190**


Summary


	HMB	GCSD	MWSD	Plant
Minimum	0.700	0.166	0.206	1.100
Average	**0.771**	**0.195**	**0.221**	**1.187**
Maximum	0.866	0.229	0.253	1.314
Distribution	**64.99%**	**16.42%**	**18.59%**	**100.0%**

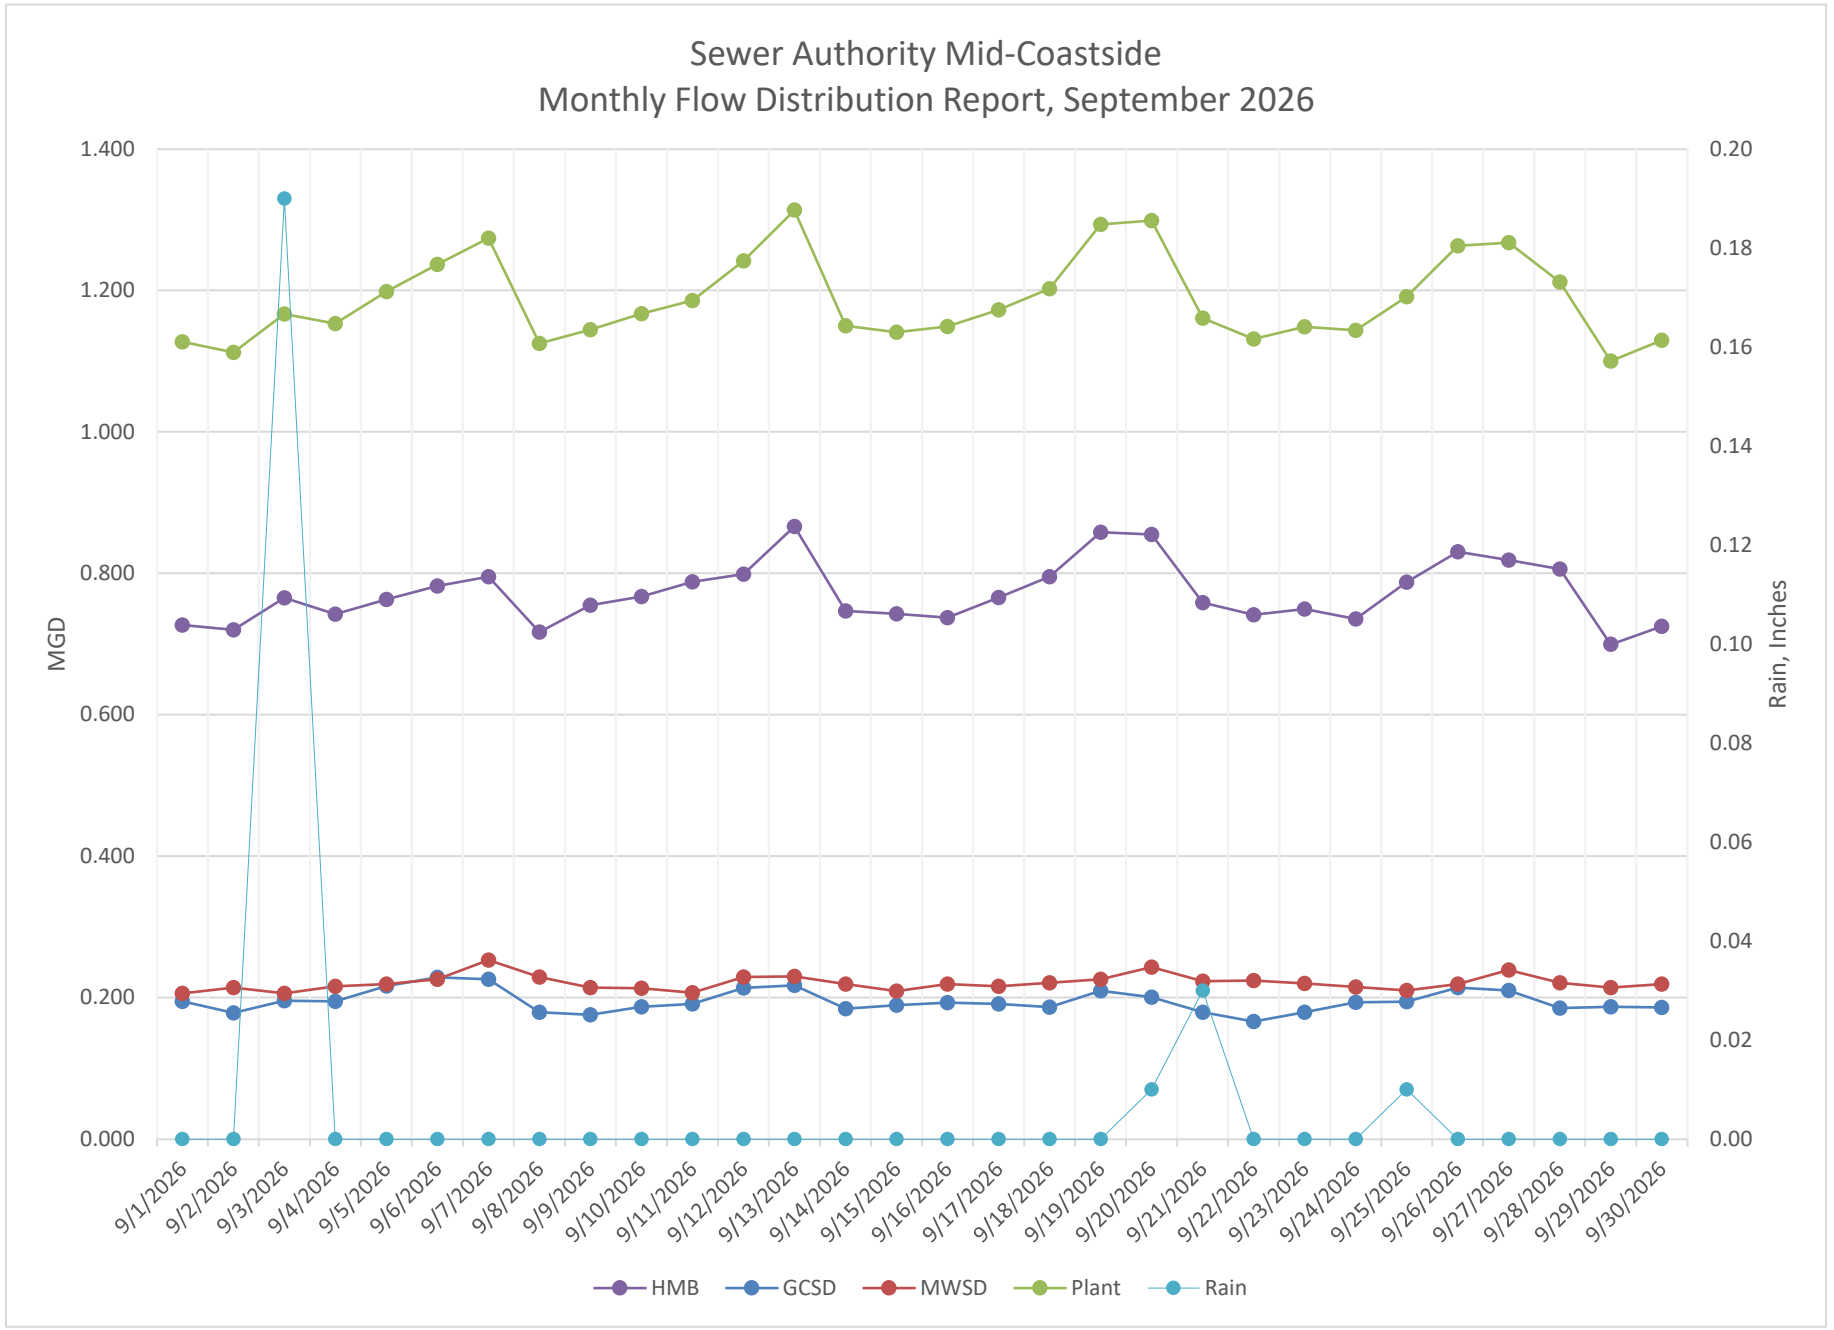
Sewer Authority Mid-Coastside
Monthly Flow Distribution Report, September 2026
MGD
Rain, Inches
1.400
1.200
1.000
0.800
0.600
0.400
0.200
0.000
0.20
0.18
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
9/1/2026
9/2/2026
9/3/2026
9/4/2026
9/5/2026
9/6/2026
9/7/2026
9/8/2026
9/9/2026
9/10/2026
9/11/2026
9/12/2026
9/13/2026
9/14/2026
9/15/2026
9/16/2026
9/17/2026
9/18/2026
9/19/2026
9/20/2026
9/21/2026
9/22/2026
9/23/2026
9/24/2026
9/25/2026
9/26/2026
9/27/2026
9/28/2026
9/29/2026
9/30/2026
HMB
GCSD
MWSD
Plant
Rain

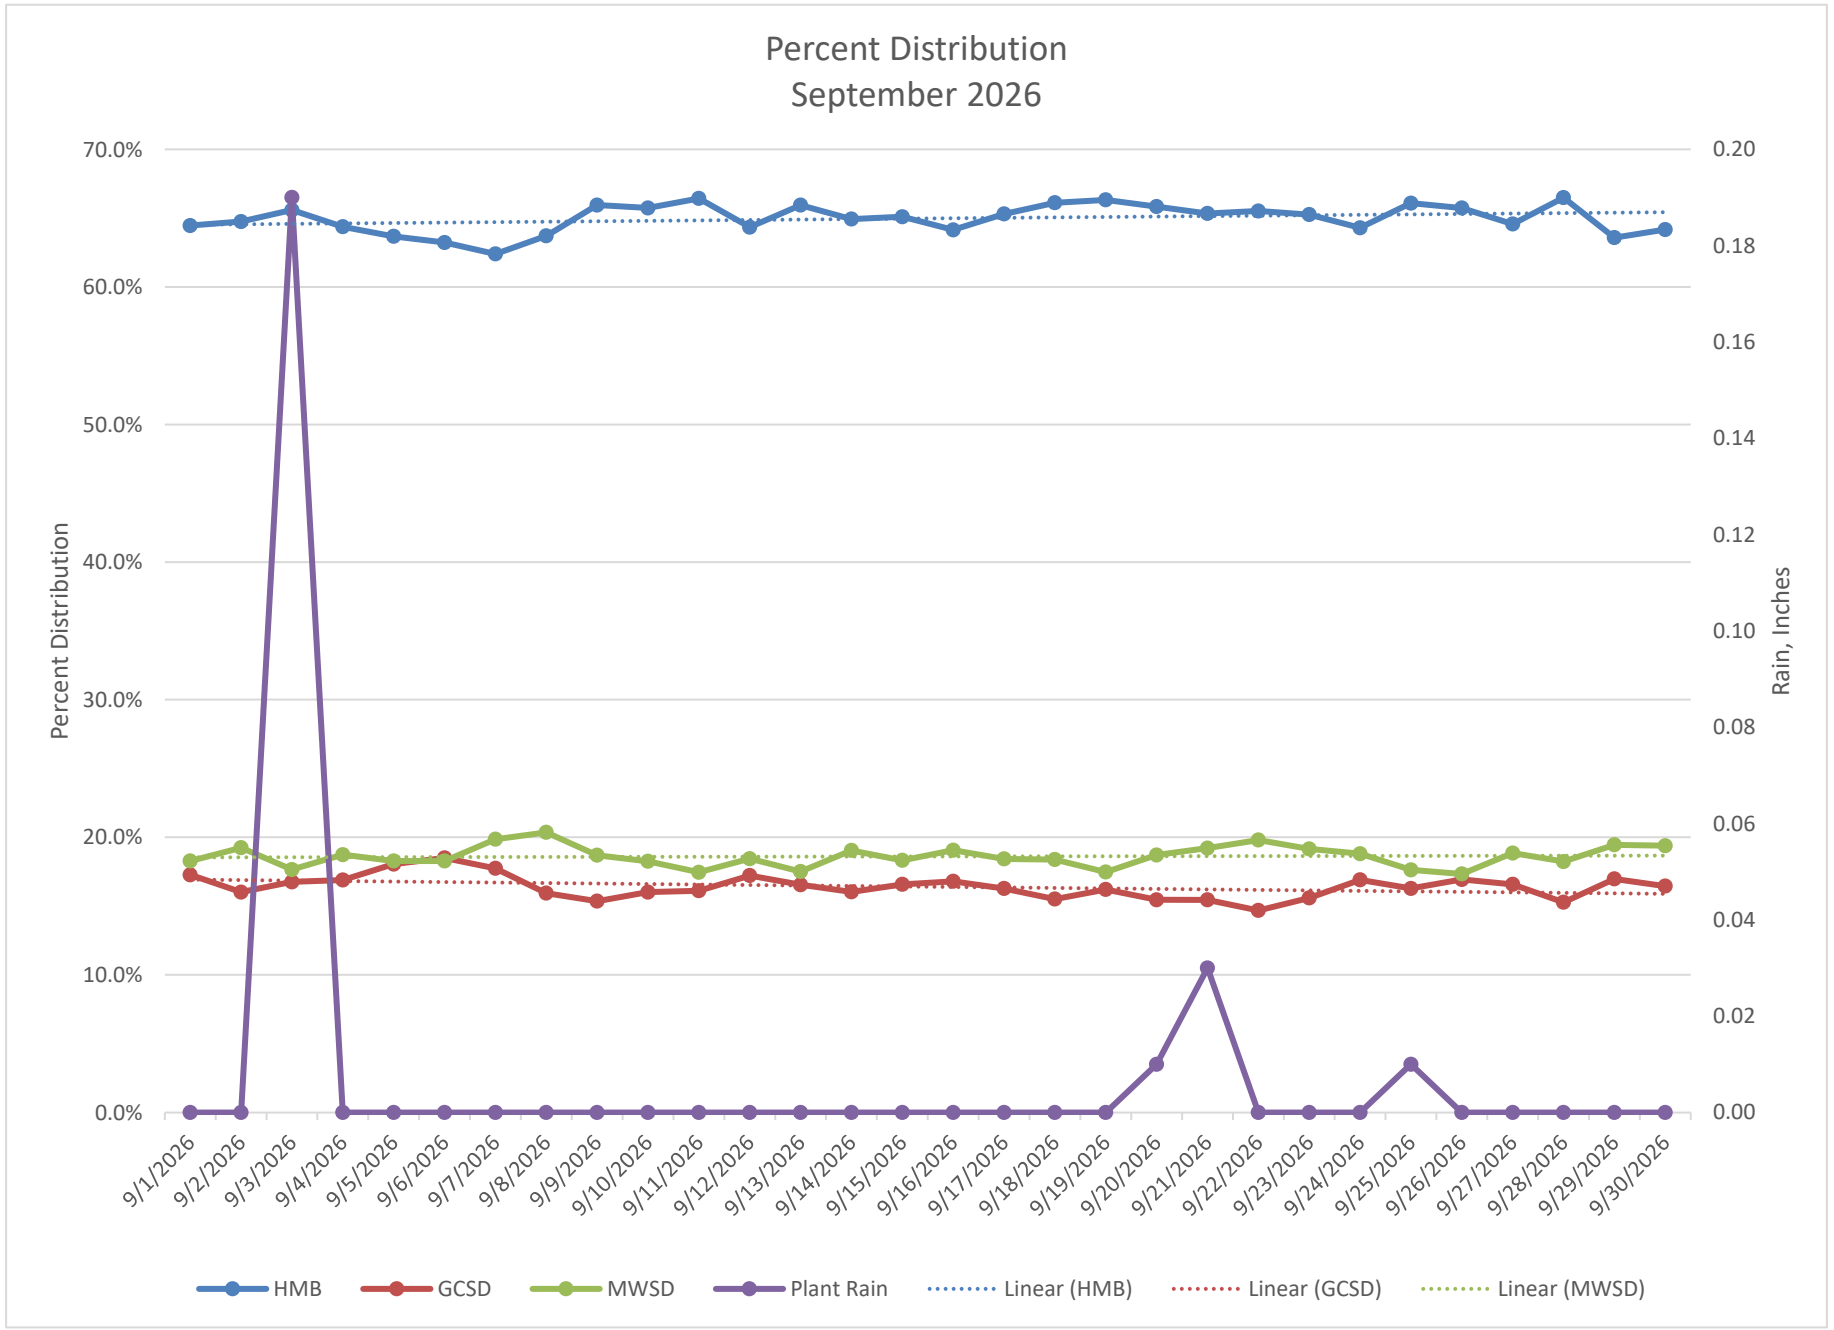
Percent Distribution
September 2026
Percent Distribution
Rain, Inches
70.0%
60.0%
50.0%
40.0%
30.0%
20.0%
10.0%
0.0%
0.20
0.18
0.16
0.14
0.12
0.10
0.08
0.06
0.04
0.02
0.00
9/1/2026
9/2/2026
9/3/2026
9/4/2026
9/5/2026
9/6/2026
9/7/2026
9/8/2026
9/9/2026
9/10/2026
9/11/2026
9/12/2026
9/13/2026
9/14/2026
9/15/2026
9/16/2026
9/17/2026
9/18/2026
9/19/2026
9/20/2026
9/21/2026
9/22/2026
9/23/2026
9/24/2026
9/25/2026
9/26/2026
9/27/2026
9/28/2026
9/29/2026
9/30/2026
HMB
GCSD
MWSD
Plant Rain
Linear (HMB)
Linear (GCSD)
Linear (MWSD)

Most recent flow calibration January 2024 PS, June 2025 Plant inf

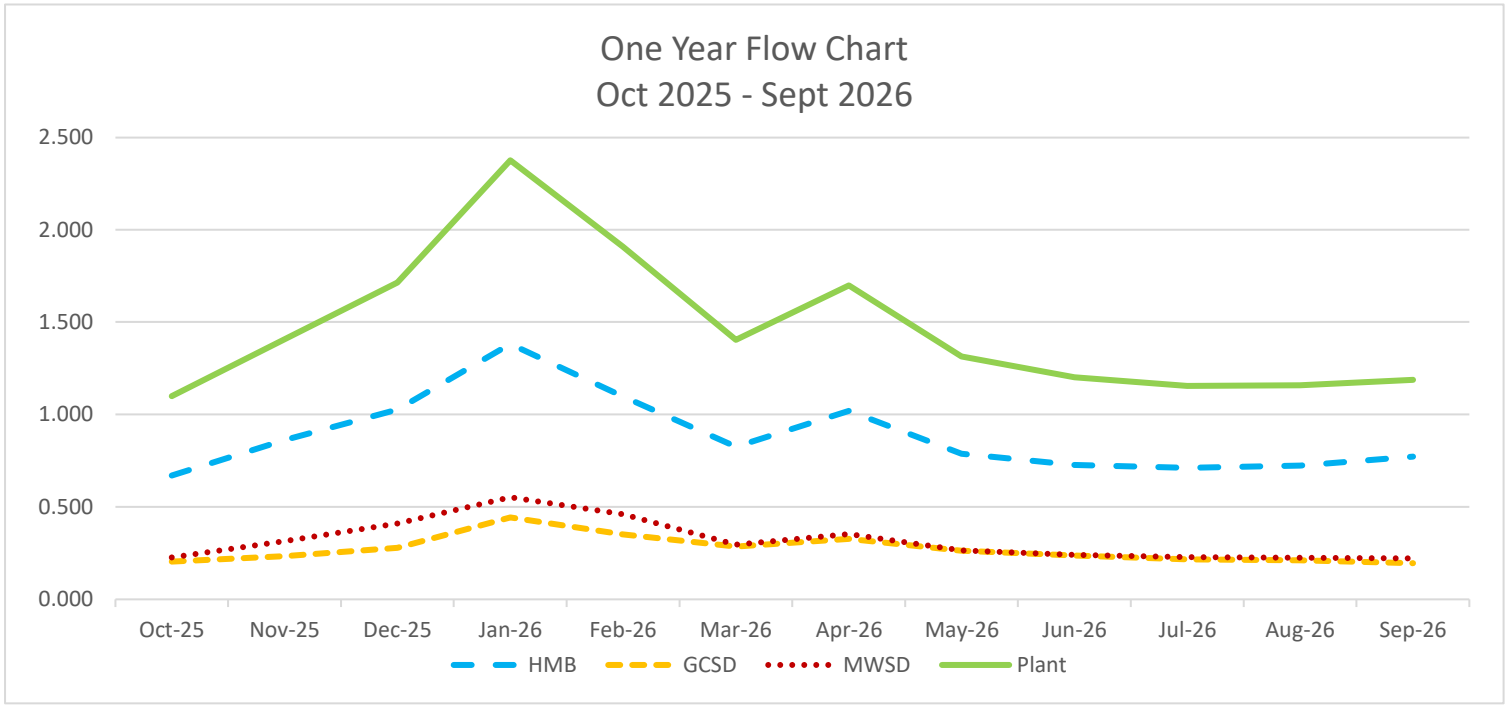

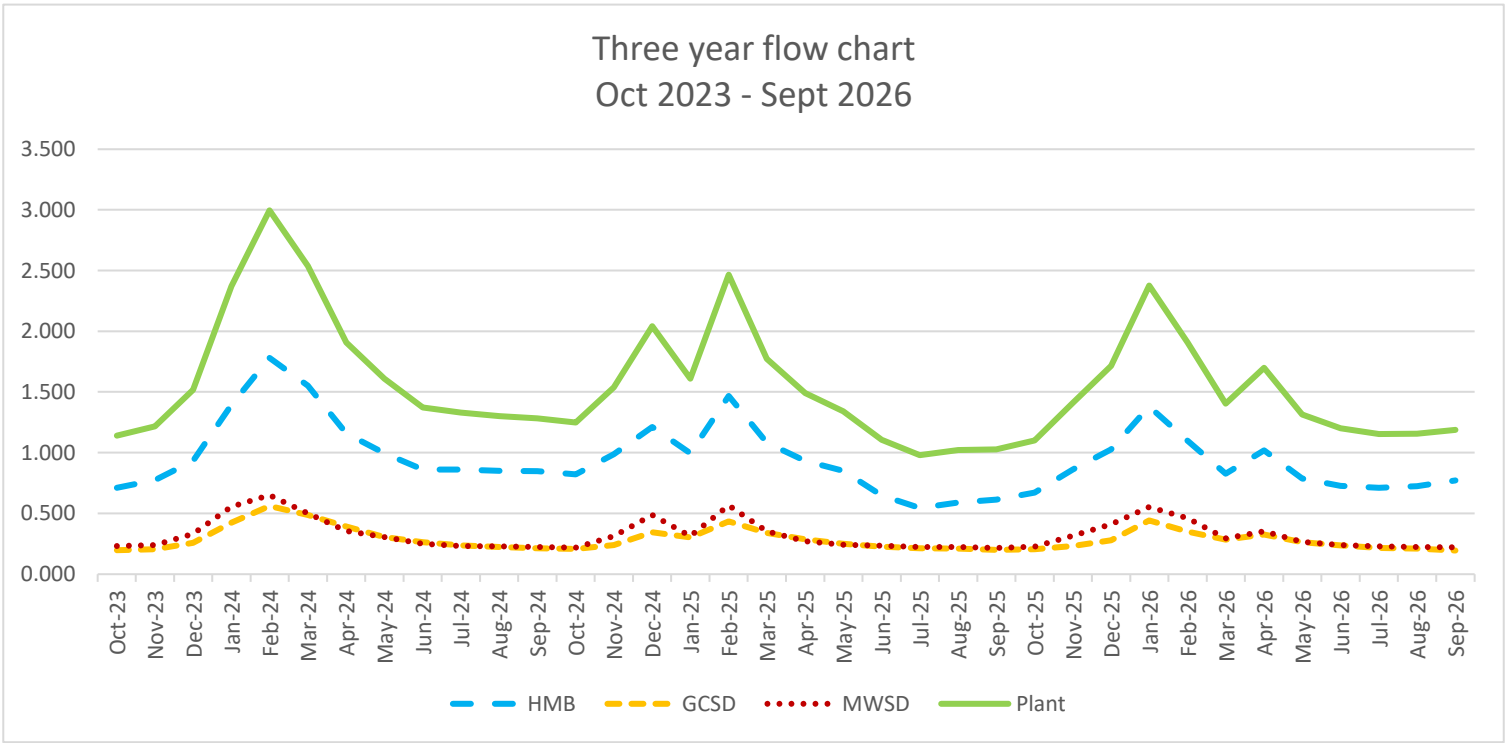

Flow based percent distribution based for past year

