



MONTARA WATER AND SANITARY DISTRICT AGENDA

Prepared for the Meeting Of: August 20, 2026

TO: BOARD OF DIRECTORS

FROM: Clemens H. Heldmaier, General Manager 

SUBJECT: SAM Flow Report for June 2026

The Sewer Authority Mid-Coastside (SAM) has prepared the following attached reports for the SAM Board of Directors and the California Regional Water Quality Control Board:

- Flow Report for June 2026
- Collection System Monthly Overflow Report June 2026

The average daily flow for Montara was 0.239 MGD in June 2026.
There were 0 reportable overflows in June 2026 in the Montara System.
SAM indicates there was 0.210 inches of rain in June 2026 in Montara.

RECOMMENDATION:

Review and File

Attachments

Sewer Authority Mid-Coastside

Monthly Collection System Activity/SSO Distribution Report, June 2026

June 2026

		Number of S.S.O's			
	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	0	0	0	0	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	0	0	0	0	0
Total	0	0	0	0	0

12 Month Moving Total

		12 month rolling Number			
	Total	HMB	GCSD	MWSD	SAM
Roots	0	0	0	0	0
Grease	1	0	0	1	0
Mechanical	0	0	0	0	0
Wet Weather	0	0	0	0	0
Other	4	1	0	1	2
Total	5	1	0	2	2
		20%	0%	40%	40%

Reportable SSOs

		Reportable Number of S.S.O.'s			
	Total	HMB	GCSD	MWSD	SAM
June 2026	0	0	0	0	0
12 Month Moving Total	5	1	0	2	2

SSOs / Year / 100 Miles

		Number of S.S.O.'s /Year/100 Miles			
	Total	HMB	GCSD	MWSD	SAM
June 2026	0.0	0.0	0.0	0.0	0.0
12 Month Moving Total	4.8	2.7	0.0	7.4	27.4
Category 1	0.0	0.0	0.0	0.0	0.0
Category 2	0.0	0.0	0.0	0.0	0.0
Category 3	3.8	2.7	0.0	3.7	27.4
Category 4	1.0	0.0	0.0	3.7	0.0
Miles of Sewers	104.5	37.0	33.2	27.0	7.3
		35.4%	31.8%	25.8%	7.0%

12 Month Rolling Total Sewer Cleaning Summary


Month	HMB	GCSD	MWSD	Total Feet	Total Miles
July - 25	4,613	9,598	5,225	19,436	3.7
Aug - 25	9,341	9,394	9,223	27,958	5.3
Sep - 25	7,017	10,039	5,058	22,114	4.2
Oct - 25	14,567	9,753	9,098	33,418	6.3
Nov - 25	12,217	16,986	10,950	40,153	7.6
Dec - 25	0	9,235	8,160	17,395	3.3
Jan - 26	0	14,510	11,677	26,187	5.0
Feb - 26	11,310	13,557	6,858	31,725	6.0
Mar - 26	14,896	12,212	6,326	33,434	6.3
Apr - 26	12,430	14,599	6,635	33,664	6.4
May - 26	12,352	12,432	4,715	29,499	5.6
June - 26	5,532	9,140	7,123	21,795	4.1

Annual ft	104,275	141,455	91,048	336,778	
-----------	---------	---------	--------	---------	--

Annual Mi.	19.7	26.8	17.2		63.8
------------	------	------	------	--	------

Attachment C

12 Month Moving SSO Totals Through June 2026

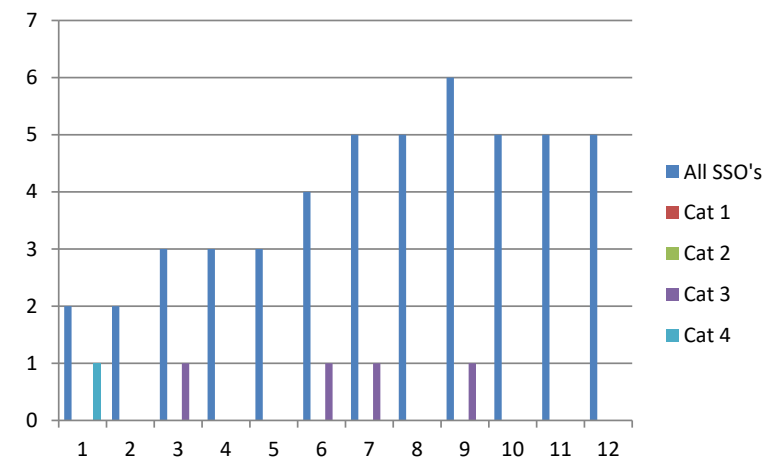

Attachment A


Flow Distribution Report Summary for June 2026

The daily flow report figures for the month of June 2026
have been converted to an Average

Daily Flow (ADF) for each Member Agency.
The results are attached for your review.

The summary of the ADF information is as follows:

	<u>MGD</u>	<u>%</u>
The City of Half Moon Bay	0.757	61.43%
Granada Community Services District	0.236	19.17%
Montara Water and Sanitary District	<u>0.239</u>	<u>19.40%</u>
Total	1.233	100.0%

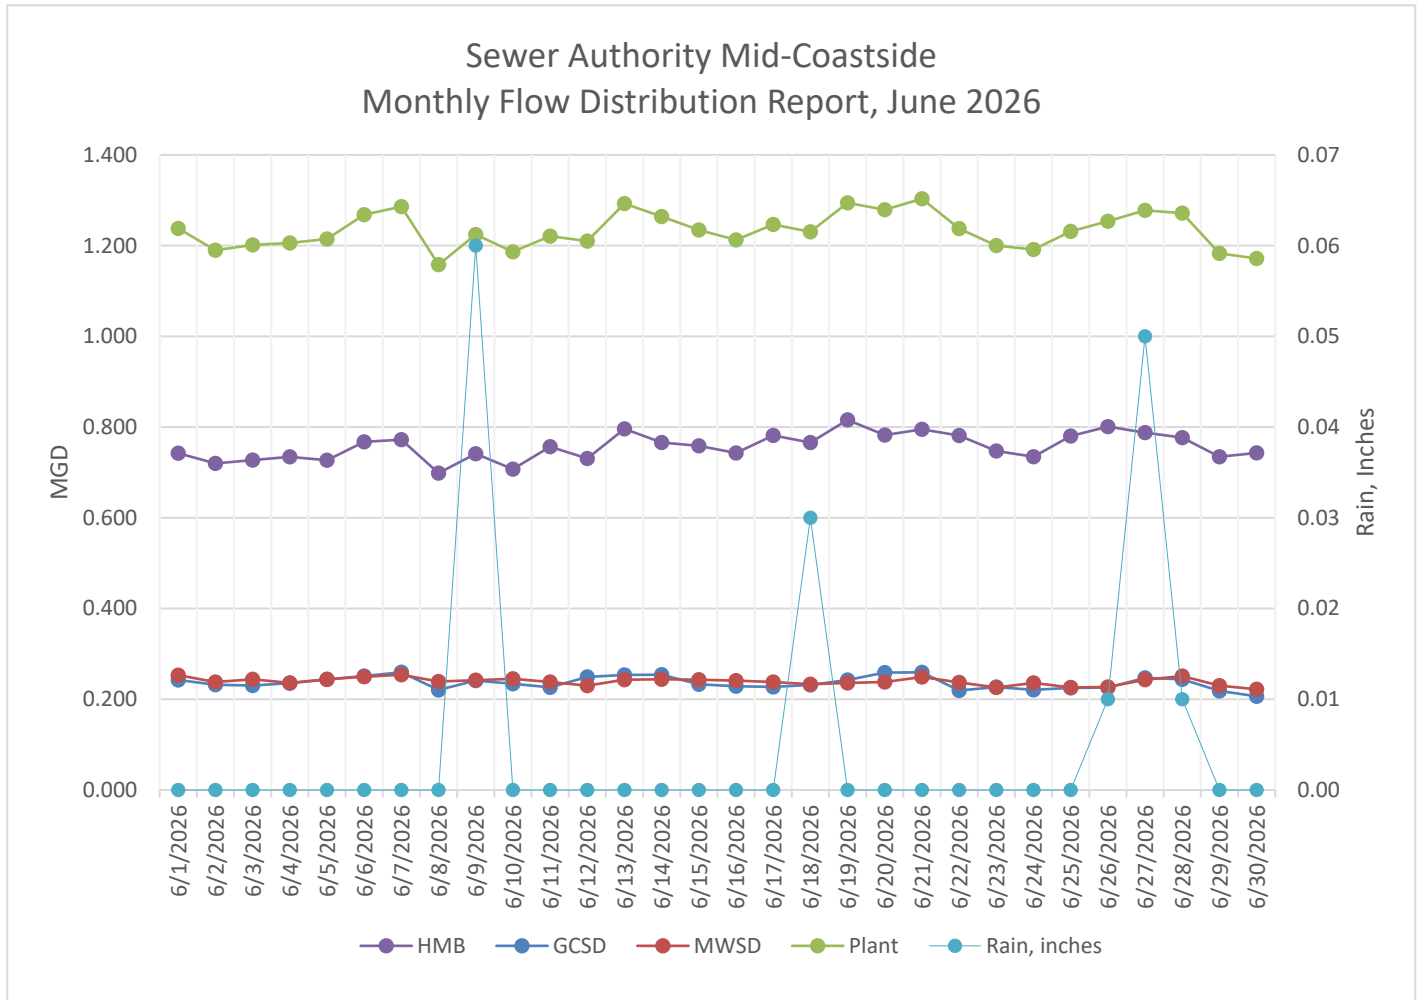

Sewer Authority Mid-Coastside


Monthly Flow Distribution Report for June 2026

<u>Date</u>	<u>HMB</u>	<u>GCSD</u>	<u>MWSD</u>	<u>Plant</u>	<u>Rain Plant</u>	<u>Rain Portola</u>	<u>Rain Montara</u>
6/1/2026	0.742	0.242	0.253	1.238	0.00	0.00	0.00
6/2/2026	0.720	0.232	0.238	1.190	0.00	0.00	0.00
6/3/2026	0.727	0.230	0.244	1.201	0.00	0.00	0.00
6/4/2026	0.734	0.235	0.236	1.206	0.00	0.00	0.00
6/5/2026	0.727	0.244	0.244	1.214	0.00	0.00	0.00
6/6/2026	0.767	0.251	0.250	1.268	0.00	0.00	0.00
6/7/2026	0.772	0.260	0.254	1.286	0.00	0.00	0.00
6/8/2026	0.699	0.221	0.239	1.158	0.00	0.00	0.00
6/9/2026	0.741	0.241	0.242	1.224	0.06	0.06	0.09
6/10/2026	0.707	0.234	0.245	1.186	0.00	0.00	0.00
6/11/2026	0.757	0.226	0.238	1.221	0.00	0.00	0.00
6/12/2026	0.731	0.249	0.230	1.210	0.00	0.00	0.00
6/13/2026	0.796	0.254	0.243	1.293	0.00	0.00	0.00
6/14/2026	0.766	0.254	0.244	1.264	0.00	0.00	0.00
6/15/2026	0.759	0.233	0.243	1.234	0.00	0.00	0.00
6/16/2026	0.743	0.229	0.241	1.213	0.00	0.00	0.00
6/17/2026	0.782	0.227	0.238	1.247	0.00	0.00	0.00
6/18/2026	0.766	0.232	0.233	1.230	0.03	0.01	0.02
6/19/2026	0.816	0.242	0.236	1.294	0.00	0.00	0.00
6/20/2026	0.782	0.259	0.238	1.279	0.00	0.00	0.00
6/21/2026	0.795	0.259	0.249	1.303	0.00	0.00	0.00
6/22/2026	0.781	0.219	0.237	1.238	0.00	0.00	0.00
6/23/2026	0.747	0.227	0.226	1.200	0.00	0.00	0.00
6/24/2026	0.735	0.221	0.236	1.191	0.00	0.00	0.00
6/25/2026	0.780	0.225	0.226	1.231	0.00	0.00	0.00
6/26/2026	0.801	0.226	0.227	1.254	0.01	0.02	0.03
6/27/2026	0.788	0.247	0.243	1.278	0.05	0.05	0.07
6/28/2026	0.777	0.244	0.251	1.272	0.01	0.00	0.00
6/29/2026	0.735	0.218	0.230	1.183	0.00	0.00	0.00
6/30/2026	0.743	0.206	0.222	1.172	0.00	0.00	0.00
Totals	22.715	7.088	7.176	36.978	0.160	0.140	0.210


Summary

	<u>HMB</u>	<u>GCSD</u>	<u>MWSD</u>	<u>Plant</u>
Minimum	0.699	0.206	0.222	1.158
Average	0.757	0.236	0.239	1.233
Maximum	0.816	0.260	0.254	1.303
Distribution	61.43%	19.17%	19.40%	100.0%



Sewer Authority Mid-Coastside Monthly Flow Distribution Report, June 2026

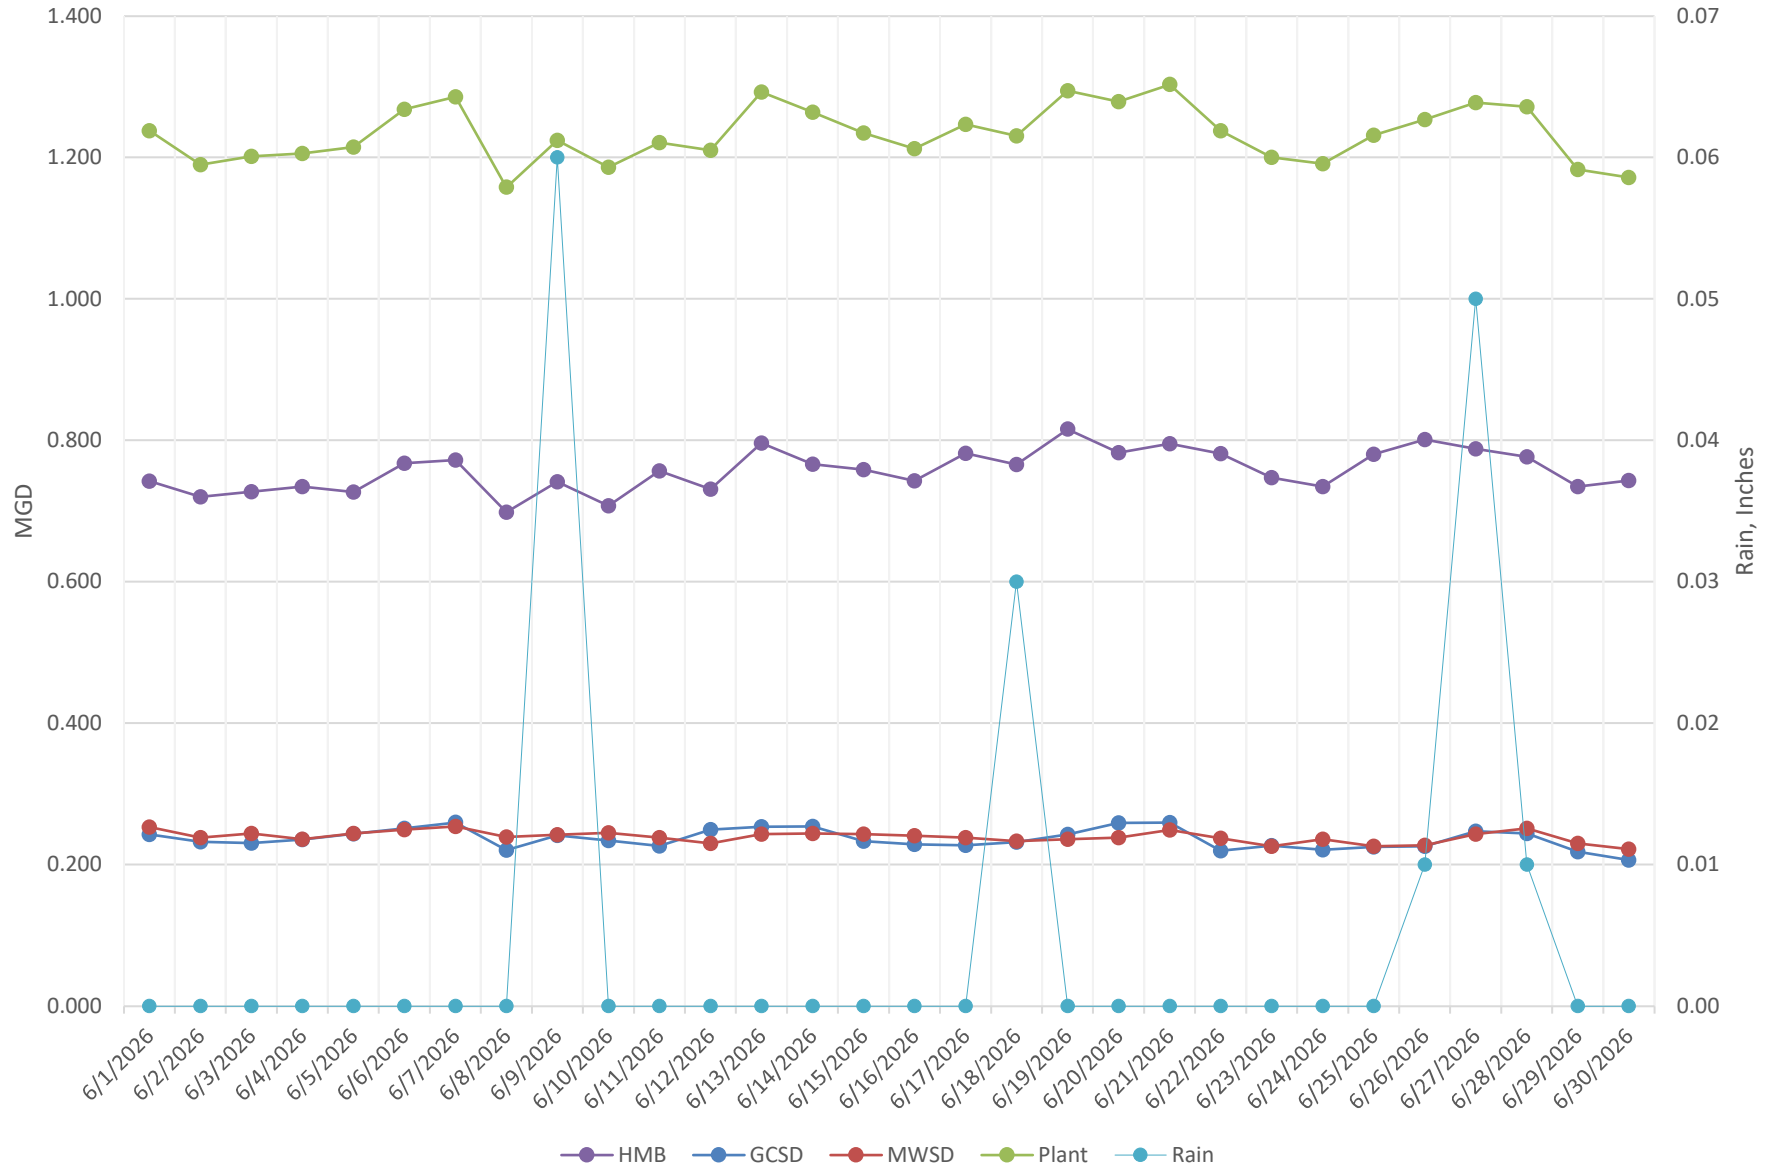

Percent Distribution June 2026

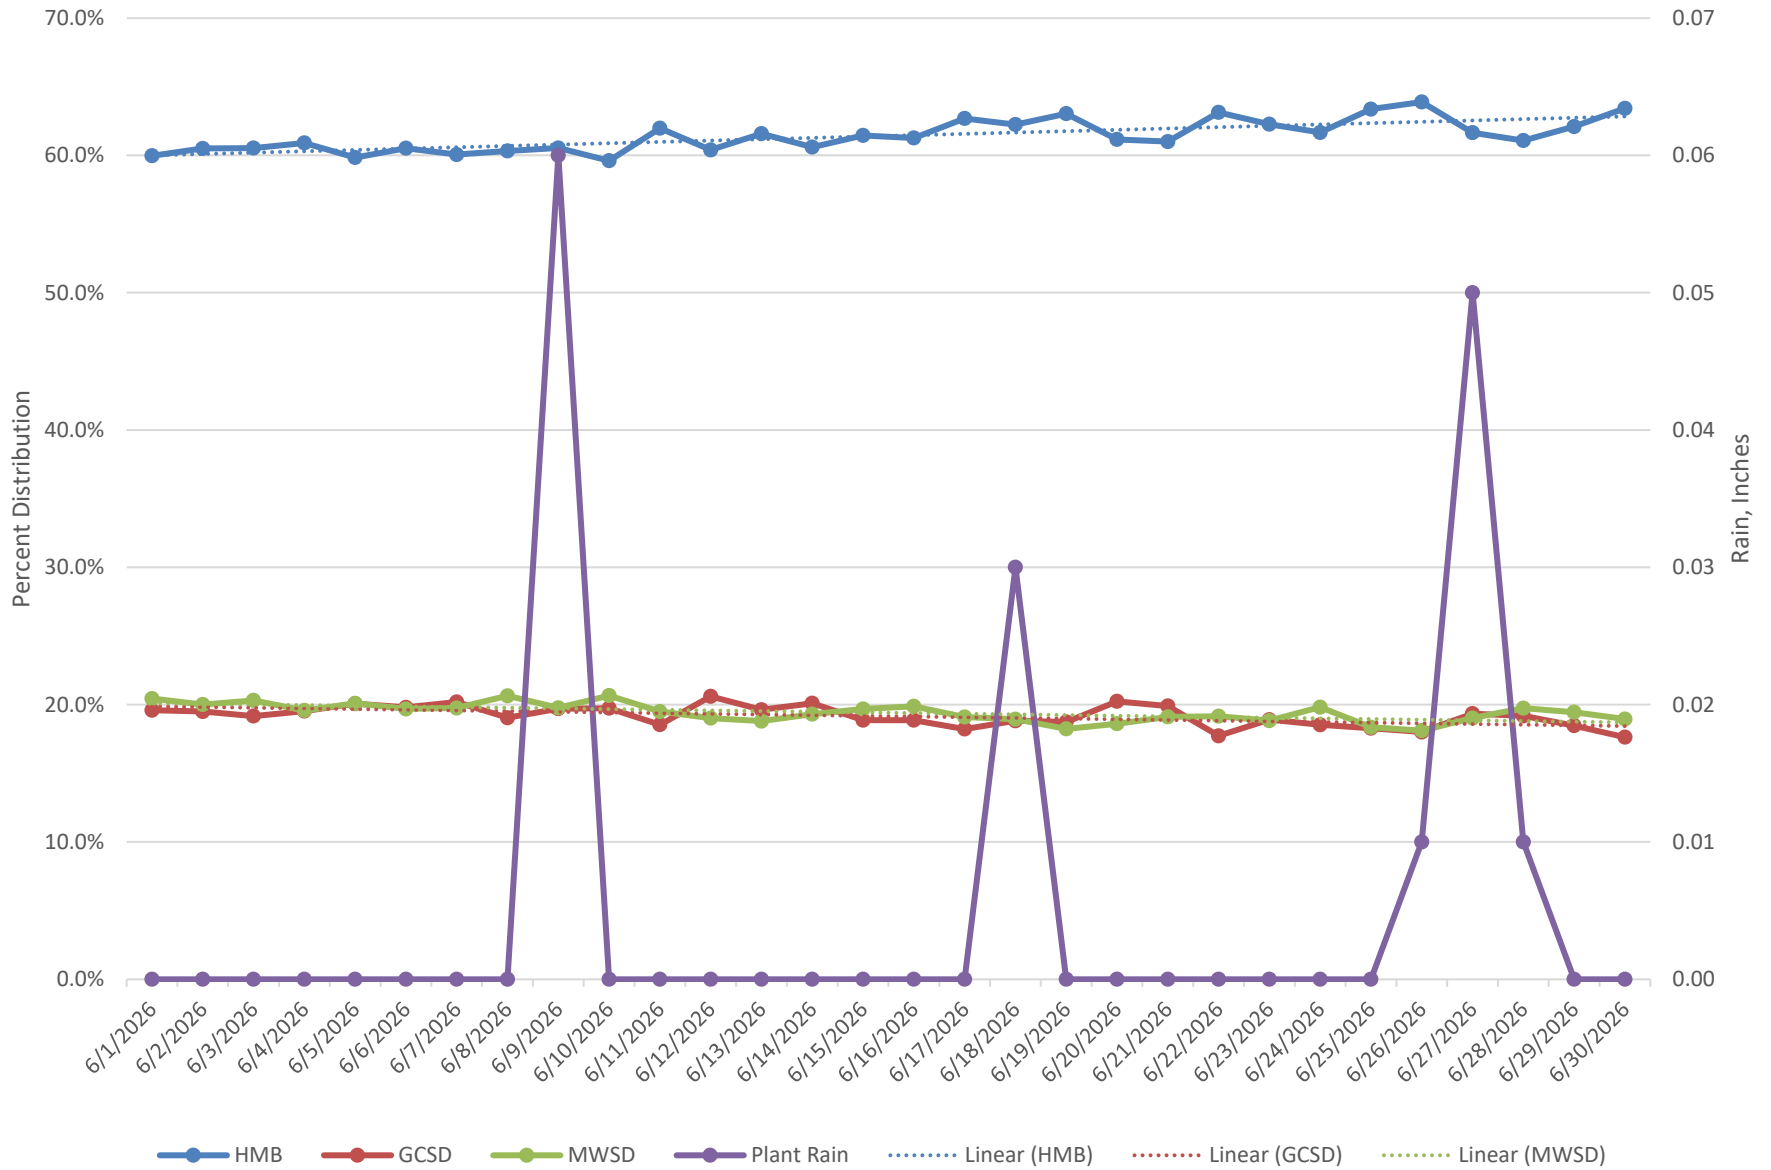

Most recent flow calibration January 2024 PS, June 2025 Plant inf

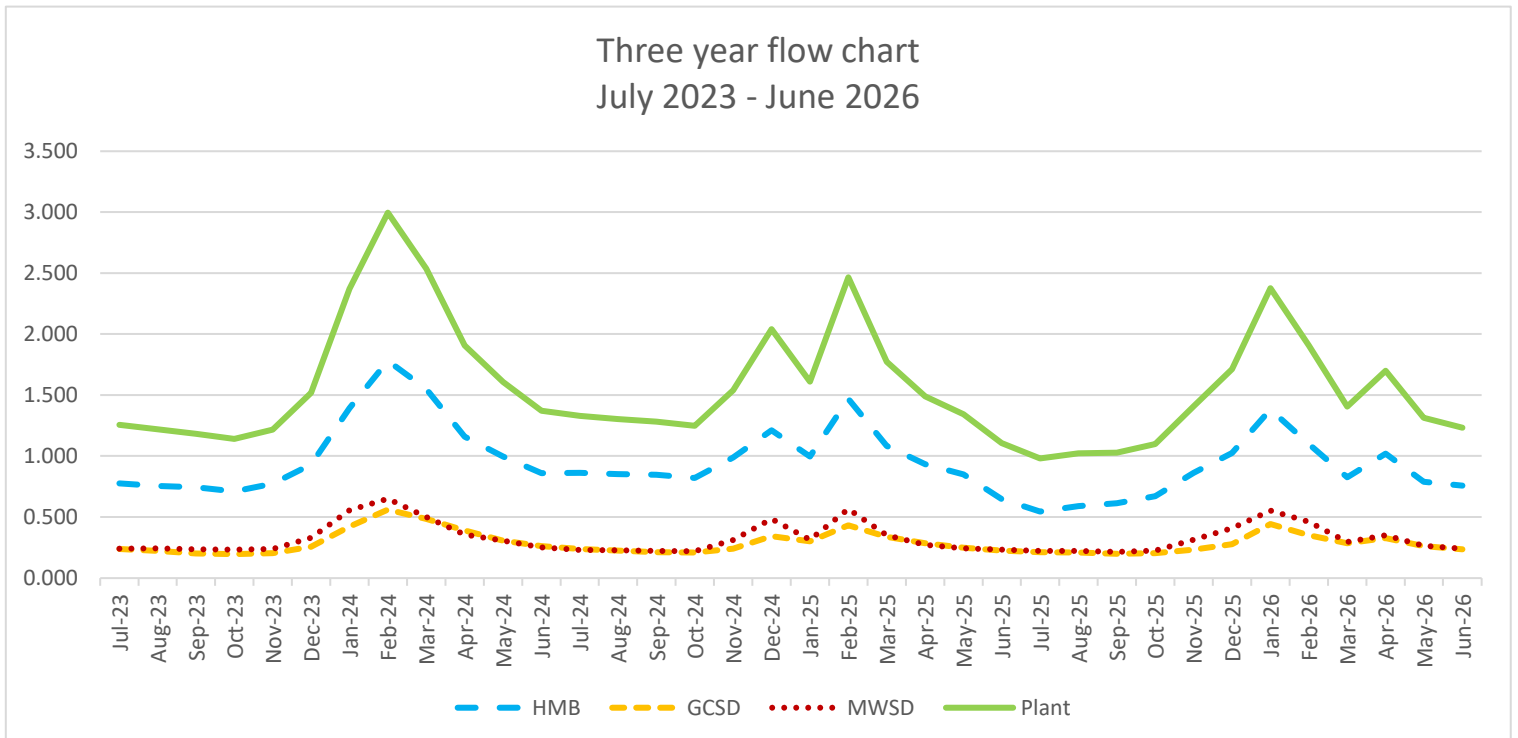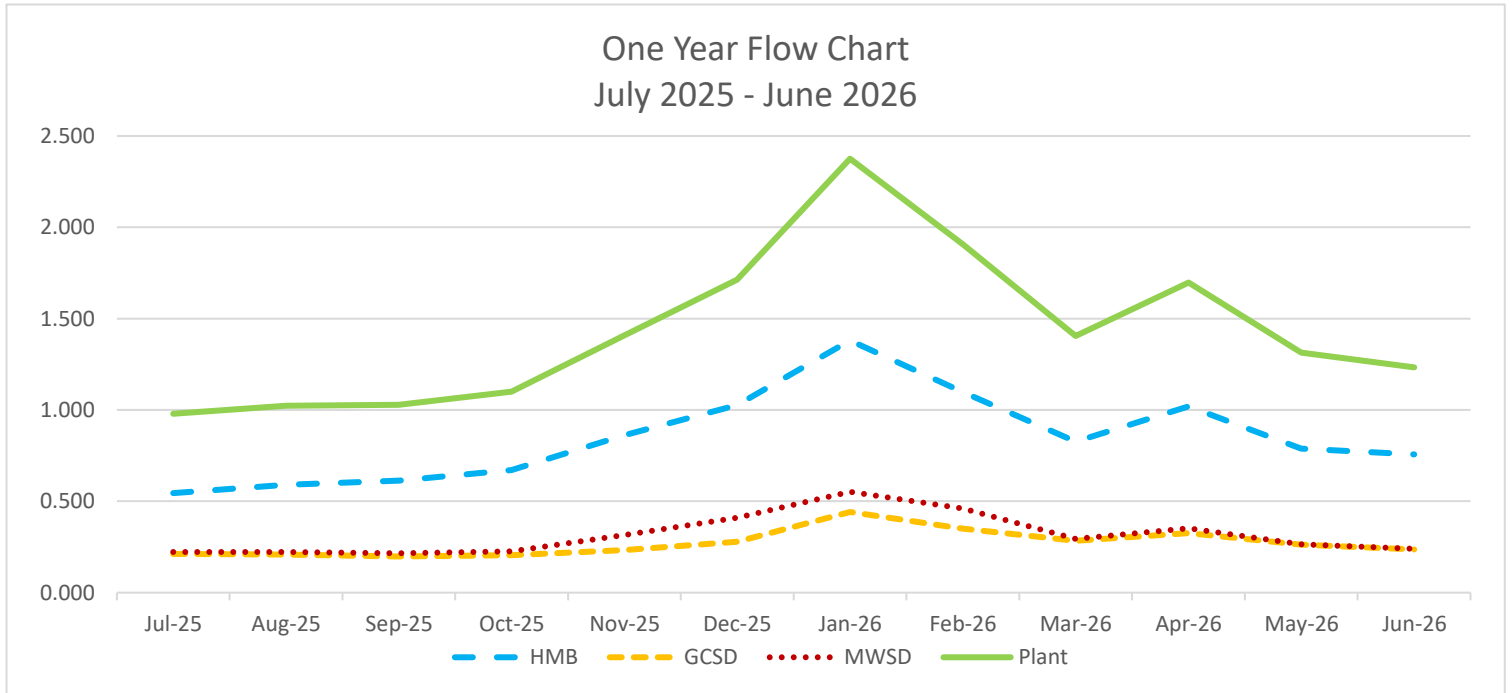

Flow based percent distribution based for past year

